


ELECTRICAL SYMBOLS LEGEND

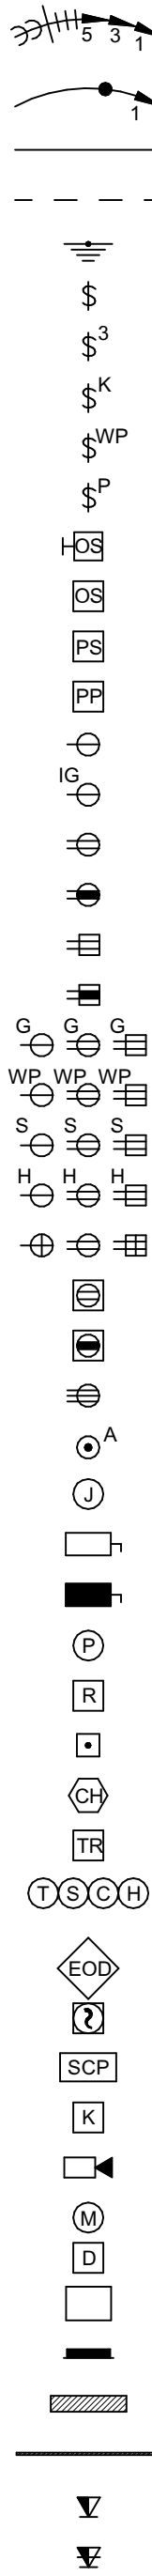

HOME RUN TO PANEL. CIRCUIT NUMBERS, PHASE, NEUTRAL, AND GROUND CONDUCTORS INDICATED ALONG WITH ISOLATED GROUND CONDUCTOR IF APPLICABLE. PARTIAL CIRCUIT.

CONDUIT INSTALLED CONCEALED ABOVE CEILING OR IN WALL.

CONDUIT INSTALLED CONCEALED BELOW FLOOR SLAB OR UNDERGROUND.

GROUND CONNECTION.

SINGLE POLE SWITCH, +3'-10" OR AS NOTED.

THREE-WAY SWITCH, +3'-10" OR AS NOTED.

KEY OPERATED SWITCH, +3'-10" OR AS NOTED.

WEATHERPROOF TOGGLE SWITCH, +3'-10" OR AS NOTED.

SINGLE POLE SWITCH WITH PILOT LIGHT, +3'-10" OR AS NOTED.

WALL MOUNTED OCCUPANCY SENSOR, +3'-10" OR AS NOTED.

CEILING MOUNTED OCCUPANCY SENSOR.

CEILING MOUNTED INTERIOR DAYLIGHT HARVESTING PHOTOCELL SENSOR.

POWER PACK, INSTALLED ABOVE ACCESSIBLE CEILING.

SIMPLEX RECEPTACLE, +18" OR AS NOTED.

ISOLATED GROUND SIMPLEX RECEPTACLE, +18" OR AS NOTED.

DUPLEX RECEPTACLE, +18" OR AS NOTED.

ISOLATED GROUND DUPLEX RECEPTACLE, +18" OR AS NOTED.

QUADRUPLEX RECEPTACLE +18" OR AS NOTED.

ISOLATED GROUND QUADRUPLEX RECEPTACLE, +18" OR AS NOTED.

GROUND FAULT INTERRUPTING RECEPTACLE, +18" OR AS NOTED.

WEATHERPROOF GROUND FAULT INTERRUPTING RECEPTACLE, +18" OR AS NOTED.

SURGE PROTECTED RECEPTACLE, +18" OR AS NOTED.

RECEPTACLE INSTALLED HORIZONTALLY AT +18" OR AS NOTED.

RECEPTACLE INSTALLED HORIZONTALLY, BOTTOM AT +6" ABOVE COUNTER TOP.

RECEPTACLE INSTALLED FLUSH IN CEILING.

ISOLATED GROUND RECEPTACLE INSTALLED FLUSH IN CEILING.

SPECIAL RECEPTACLE, NEMA STYLE AS NOTED, +18" OR AS NOTED.

FLUSH FLOOR MOUNTED RECEPTACLE, LETTER INDICATES TYPE.

JUNCTION BOX.

DISCONNECT SWITCH, TOP AT +6'-0" OR AS NOTED.

DISCONNECT SWITCH PROVIDED WITH EQUIPMENT.

EXTERIOR PHOTOCELL, INSTALLED ON ROOF FACING NORTH.

CONTROL OR POWER RELAY, INSTALLED AS NOTED.

PUSHBUTTON, TOP AT +4'-6" OR AS NOTED.

DOOR BELL CHIMEM, +8'-0" OR AS NOTED.

CONTROL TRANSFORMER, INSTALLED AS NOTED.

THERMOSTAT, TEMPERATURE SENSOR, CARBON DIOXIDE SENSOR AND HUMIDISTAT PROVIDED BY MECHANICAL CONTRACTOR, +3'-10" OR AS NOTED.

ELECTRICALLY OPERATED DAMPER, PROVIDED BY MECHANICAL CONTRACTOR.

120 VOLT DUCT TYPE SMOKE DETECTOR, PROVIDED BY MECHANICAL CONTRACTOR.

SECURITY SYSTEM CONTROL PANEL, TOP AT 6'-0".

KEYPAD, +46" OR AS NOTED.

SECURITY CAMERA.

MOTION DETECTOR, CEILING MOUNTED.

DOOR CONTACTS.

TRANSFORMER, FLOOR MOUNTED OR SUSPENDED FROM STRUCTURE AS NOTED.

BRANCH CIRCUIT PANELBOARD, TOP AT +6'-0" OR AS NOTED.

DISTRIBUTION PANEL, TOP AT +6'-0" OR AS NOTED.

PLYWOOD PHONEBOARD, INSTALLED AS NOTED.

TELEPHONE/DATA OUTLET, +18" WITH 1" CONDUIT TO ABOVE CEILING.

TELEPHONE/DATA OUTLET, +6" WITH ABOVE COUNTER WITH 1" CONDUIT TO ABOVE CEILING.

GENERAL REFERENCES/NOTATIONS:

AC	MOUNT DEVICE +6" ABOVE TOP OF COUNTER TO BOTTOM OF DEVICE.
+48"	MOUNTING HEIGHT ABOVE FINISHED FLOOR TO CENTERLINE OF DEVICE.
03/E5	DETAIL OR SECTION REFERENCE.
???	FOODSERVICE EQUIPMENT DESIGNATION.
#	REVISION DESIGNATION.
TYP ?	EQUIPMENT DESIGNATION.

ABBREVIATIONS:

AF/AFG	ABOVE FINISHED FLOOR/GRADE.	NEC	NATIONAL ELECTRICAL CODE.
AHJ	AUTHORITY HAVING JURISDICTION.	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION.
BAS	BUILDING AUTOMATION SYSTEM.	NL	NIGHT LIGHT.
DNR	DEPARTMENT OF NATURAL RESOURCES.	NF	NON-FUSED.
EC	ELECTRICAL CONTRACTOR.	PA	PUBLIC ADDRESS.
EM	EMERGENCY.	PC	PLUMBING CONTRACTOR.
ETR	EXISTING TO REMAIN.	SPD	SURGE PROTECTION DEVICE.
FA	FIRE ALARM.	TYP	TYPICAL.
FPC	FIRE PROTECTION CONTRACTOR.	UL	UNDERWRITERS LABORATORIES.
FSEC	FOOD SERVICE EQUIPMENT CONTRACTOR.	UNO	UNLESS NOTED OTHERWISE.
GC	GENERAL CONTRACTOR.	UPS	UNINTERRUPTIBLE POWER SUPPLY.
MC	MECHANICAL CONTRACTOR.	WP	WEATHERPROOF.

- SYMBOL & LEGEND NOTES:
- REFER TO LIGHT FIXTURE SCHEDULE FOR SPECIFICATION AND INFORMATION ON ALL LUMINAIRES.
 - REFER TO SPECIFICATIONS AND PLAN NOTES FOR DETAILED DESCRIPTION OF ALL DEVICES SHOWN IN THIS SCHEDULE, PROVIDED BY THIS CONTRACTOR.
 - MOUNTING HEIGHTS INDICATED ARE MEASURED FROM FINISHED FLOOR TO THE CENTERLINE OF THE DEVICE UNLESS NOTED OTHERWISE.

ELECTRICAL GENERAL NOTES

- INCLUDE ALLOWANCE FOR UNFORSEEN CONDITIONS THAT MAY EFFECT THE SCOPE OF WORK. MINOR DEVIATIONS REQUIRED FOR ACCOMPLISHING THE INTENT OF THIS DESIGN ARE TO BE INCLUDED IN THIS ALLOWANCE.
- ELECTRICAL DESIGN HAS BEEN BASED ON THE INSTALLATION OF 75°C CONDUCTORS CONNECTED TO TERMINAL LUGS AND EQUIPMENT U.L. LISTED FOR A MINIMUM 75°C CONDUCTORS TERMINATED ON EQUIPMENT WITH A LOWER RATING 60°C) OR NO RATING SHOWN TO HAVE CONDUCTOR SIZE INCREASED TO CONFORM TO ADOPTED ELECTRICAL CODE AND UL/CUL NO. 489 REQUIREMENTS.
- CONDUIT INSTALLED INDOORS SHALL BE ELECTRICAL METALLIC TUBING (EMT), MINIMUM 1/2" OR AS NOTED.
- CONDUIT INSTALLED BELOW SLAB SHALL BE RIGID STEEL, IMC, PVC OR HDPE, MINIMUM 3/4". IF PVC OR HDPE IS USED, TRANSITION TO RIGID STEEL BEFORE TURNING UP AND PENETRATING FLOOR SLAB.
- CONDUCTORS SHALL BE A MINIMUM OF #12 THHN/THWN COPPER UNLESS NOTED OTHERWISE ON PLANS OR IN SPECIFICATIONS. BRANCH CIRCUITS SHALL BE PROVIDED WITH (2) #12 CONDUCTORS AND (1) #12 EQUIPMENT GROUND CONDUCTOR UNLESS NOTED OTHERWISE.
- BRANCH CIRCUITS SHOWN WITH TWO GROUNDING CONDUCTORS SHALL HAVE ONE EQUIPMENT GROUND CONDUCTOR (GREEN) AND ONE ISOLATED GROUND CONDUCTOR (GREEN W/ YELLOW STRIP) INSTALLED IN RACEWAY.
- DIRECT CURRENT WIRING SHALL BE (2) #10 IN 1/2" CONDUIT UNLESS NOTED OTHERWISE.
- CONTROL VOLTAGE WIRING SHALL BE PLENUM RATED OR INSTALLED IN CONDUIT.
- PROVIDE FLEXIBLE CONNECTIONS ONLY FOR FINAL CONNECTION TO EQUIPMENT, 6'-0" MAXIMUM LENGTH. PROVIDE LIQUID TIGHT FLEXIBLE EQUIPMENT, 6'-0" MAXIMUM LENGTH. PROVIDE LIQUID TIGHT FLEXIBLE CONNECTION AT EXTERIOR LOCATIONS AND WHERE EXPOSURE TO MOISTURE IS POSSIBLE.
- ALL EMPTY CONDUITS SHALL BE PROVIDED WITH A PULL WIRE.
- ALL RACEWAYS SHALL CONTAIN A GROUNDING ELECTRODE SIZED PER THE ADOPTED ELECTRICAL CODE.
- COORDINATE WORK ABOVE THE CEILING WITH OTHER TRADES TO PROVIDE THE GREATEST POSSIBLE CLEARANCE. CONDUIT RUNS SHALL BE RUN THROUGH TRUSSES WHERE POSSIBLE.
- VERIFY EXACT PLACEMENT OF ALL DEVICES SHOWN ON THE CONSTRUCTION DOCUMENTS PRIOR TO FINAL PLACEMENT.
- ALL PANELBOARDS, SWITCHBOARDS AND LINE VOLTAGE CONTROL EQUIPMENT SHALL BE FIELD MARKED TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS. MARKING SHALL BE LOCATED SO AS TO BE CLEARLY VISIBLE TO QUALIFIED PERSONS BEFORE EXAMINATION, ADJUSTING, SERVICING OR MAINTENANCE OF EQUIPMENT. MARKING SHALL BE SLEF ADHESIVE, COMMERCIAL LABEL CONFORMING TO ADOPTED CODES.
- LIGHT SWITCHES, ELECTRICAL OUTLETS, THERMOSTATS AND OTHER ENVIRONMENTAL CONTROLS LOCATED NO HIGHER THAN 48" AND NO LOWER THAN 15" ABOVE THE FLOOR. IF THE REACH IS OVER AN OBSTRUCTION BETWEEN 20" AND 25" IN DEPTH, THE MAXIMUM HEIGHT IS TO BE REDUCED TO 44" FOR FORWARD APPROACH OR 48" FOR SIDE APPROACH. PROVIDED THE OBSTRUCTION IS NO MORE THAN 24" IN DEPTH. OBSTRUCTIONS SHALL NOT EXTEND MORE THAN 25" FROM THE WALL BENEATH A CONTROL.
- TERMS: SHALL - ACTION THAT IS REQUIRED WITHOUT OPTION OR QUALIFICATION. FURNISH - CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING. INSTALL - CONTRACTOR SHALL BE RESPONSIBLE FOR LABOR AND CONSTRUCTION EQUIPMENT NECESSARY TO SET IN PLACE, CONNECT, CALIBRATE AND/OR TEST EQUIPMENT FURNISHED BY HIM OR OTHERS. PROVIDE - CONTRACTOR SHALL FURNISH AND INSTALL.

REMODEL GENERAL NOTES

- ALL EXISTING EQUIPMENT, WIRING DEVICES, LIGHTS, CONDUIT, WIRING, CIRCUITING, ETC., NOT DISTURBED BY NEW CONSTRUCTION WORK SHALL BE MAINTAINED AND UNDAMAGED. THESE DEVICES, IF SHOWN, ARE SHOWN FOR INFORMATION PURPOSES ONLY. VISIT THE JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND FAMILIARIZE THEMSELVES WITH ALL WORK TO BE DONE AT THE JOB SITE. FAILURE TO DO SO SHALL NOT RELIEVE CONTRACTOR OF THE RESPONSIBILITY FOR PERFORMING ALL WORK NECESSARY TO PROVIDE A WORKMANLIKE INSTALLATION.
- EXISTING SERVICES (ELECTRICAL, FIRE ALARM, ETC.) SHALL NOT BE INTERRUPTED WITHOUT PRIOR SCHEDULING OF SUCH OUTAGES WITH THE OWNER, ARCHITECT, AND ALL OTHER PARTIES INVOLVED.
- MAINTAIN ACCURATE RECORDS OF ALL MODIFICATIONS TO EXISTING SYSTEMS WHICH ARE TO REMAIN. DELIVER ALL "RECORD" DRAWINGS TO THE OWNER INDICATING SUCH CHANGES.
- DISCONNECT AND LABEL ABANDONED FEEDERS AND CIRCUITS.
- REMOVE ALL EXPOSED CONDUITS, CONDUITS ABOVE LAY-IN CEILINGS, OR EQUIPMENT WHICH IS ABANDONED.
- WHERE NEW WORK INTERFERES WITH CIRCUITS IN ROOMS OTHERWISE UNDISTURBED, EXISTING CIRCUITS SHALL BE REWORKED AS REQUIRED TO MAINTAIN SERVICE.
- ALL EQUIPMENT, FIXTURES, PANELBOARDS, CONDUIT AND WIRING THAT ARE REMOVED SHALL BE REMOVED FROM THE JOB SITE, UNLESS DIRECTED OTHERWISE BY THE ARCHITECT OR OWNER'S REPRESENTATIVE.
- EXISTING ROUGH-IN BOXES AND CONDUIT MAY BE UTILIZED IF THEY ARE OF PROPER SIZE AND IN SUITABLE LOCATION(S) FOR NEW CONSTRUCTION. DEVICES AND WIRING SHALL BE NEW.
- CIRCUIT ROUTINGS SHOWN IN REMODELED AREAS MAY BE MODIFIED TO SUIT FIELD CONDITIONS. KEEP DEVICES AND/OR FIXTURE CIRCUITS APPROXIMATELY AS INDICATED TO LIMIT VOLTAGE DROP OF FEEDER AND BRANCH CIRCUITS.
- VERIFY THE LOCATION AND CONDITION OF ALL EXISTING UTILITIES AND PROTECT DURING THE COURSE OF THEIR WORK. EXISTING UTILITIES, BUILDING MATERIALS AND ANY ASSOCIATED ITEMS WHICH ARE DAMAGED BY CONTRACTOR'S NEGLIGENCE SHALL BE REPAIRED OR REPLACED AT THE CONTRACTOR'S EXPENSE (IN A TIMELY MANNER) AND TO THE OWNER'S APPROVAL.
- COORDINATE THE REMOVAL OR RELOCATION OF ALL MECHANICAL AND PLUMBING EQUIPMENT. DISCONNECT AND REMOVE ALL ELECTRICAL POWER AND CONTROL CIRCUITS FOR EQUIPMENT BEING REMOVED OR RELOCATED. EXISTING CONDUIT AND ROUGH-IN MAYBE USED FOR RELOCATED OR NEW EQUIPMENT. ALL CONDUCTORS SHALL BE NEW.
- REMOVE ALL EXISTING DATA, TELEPHONE, FIRE ALARM CABLING AND ANY OTHER LOW VOLTAGE WIRING THAT ARE NOT TO BE USED.
- DESIGN IS BASED ON FIELD INFORMATION, AS-BUILT DRAWINGS AND OWNER FURNISHED INFORMATION. VERIFY ACCURACY OF ALL EXISTING CONDITIONS. IN CASE OF DISCREPANCY, PROVIDE ALL NECESSARY CONDUIT, WIRE, BOXES, FITTINGS, ETC. FOR A COMPLETE OPERATING ELECTRICAL SYSTEM. ENTIRE INSTALLATION TO COMPLY WITH SPECIFICATIONS AND ADOPTED ELECTRICAL CODE.

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. OTHER SHEETS INCLUDING SPECIFICATIONS APPLY. THAT SHOWN HEREON IS SCHEMATIC IN NATURE AND NOT TO BE USED AS A SHOP DRAWINGS. THEREFORE, INCLUDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS AND THE EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS AS SHOWN ON THEIR RESPECTIVE DOCUMENTS. THESE ELEMENTS ARE SHOWN FOR REFERENCE AND SHALL BE VERIFIED PRIOR TO CONSTRUCTION AND THE ENGINEER ASSUMES NO LIABILITY FOR THE ACCURACY OF THESE ELEMENTS. NO DESIGN RESPONSIBILITY IS ASSUMED FOR ANY PORTION OF THE WORK THAT THE PROFESSIONAL ENGINEER HAS NOT SIGNED AND SEALED PER STATE REQUIREMENTS.

Dialectic

Dialectic, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108
Florida Certificate of
Authorization Number 8039

T 816-997-9601
F 816-997-9602
DialecticEng.com
Copyright 2019

Date

LEGEND & KEYNOTES

Approved By:
Orange County
Division of Building Safety

E0.0

08/13/21



#718

7419 International Dr.
Orlando, FL 32819

Owner:


CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Bill Pounds

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: 816-997-9627
Contact: Joe Hillebrenner, P.E.

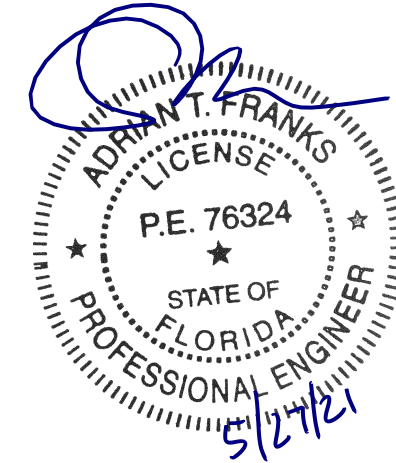



No.	Description	Date
-----	-------------	------

DRAWN BY: JGM

CHECKED BY: ATF

PROJ. NO: 94-21751

Copyright PKWY Architects, LLC 2019 ©

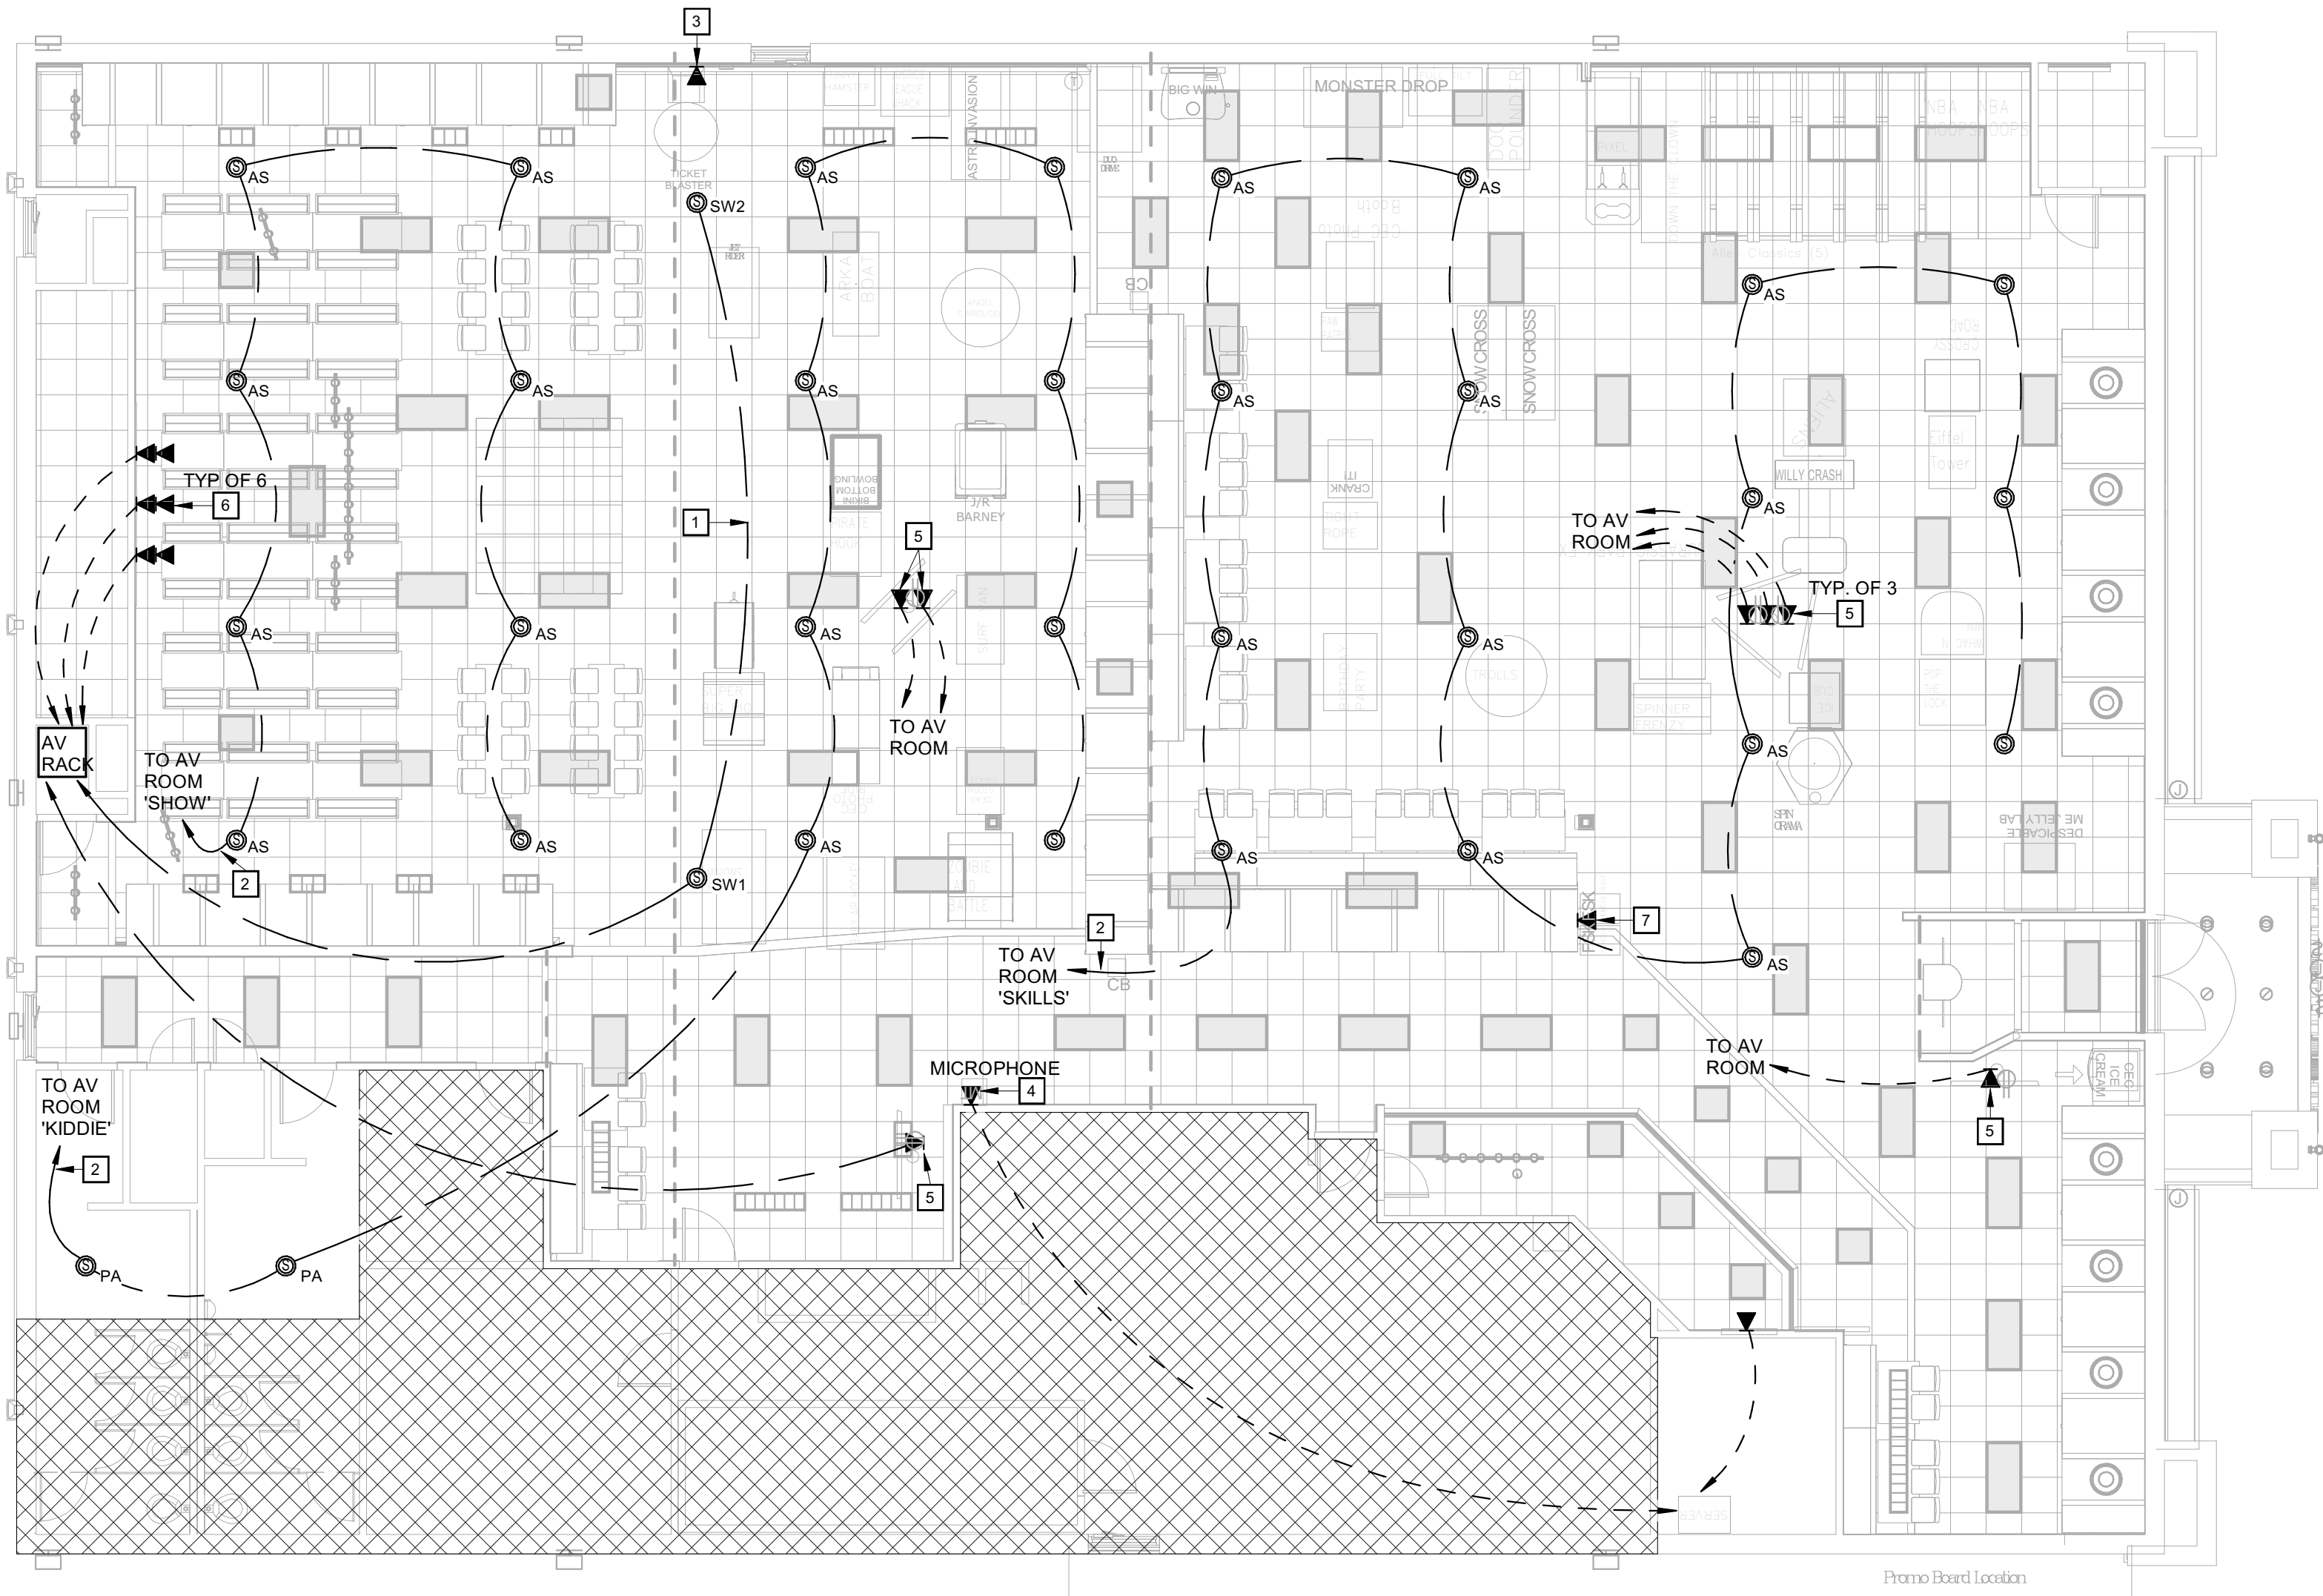

1 SPEAKER PLAN

1/8" = 1'-0"

SPEAKER PLAN LEGEND:

- AS ATLAS SPEAKER (CEILING)
- PA RESTROOM SPEAKER (CEILING)
- SW CEILING SUBWOOFER
- AUDIO
- DATA/MONITOR


SPEAKER NOTES

1. INSTALL NEW ATLAS FAP42T SPEAKERS AT 16'-0" ON CENTER MAX. OR AS INDICATED. SET TO 70V, 16W
2. DO NOT INSTALL SPEAKERS OVER THE FOLLOWING:
 - 2A. FURNITURE
 - 2B. SKYTUBES
 - 2C. MERCHANDISE OR POS STATIONS
 - 2D. BEVERAGE BAR
 - 2E. SKEEBALL OR ALLEY ROLLER CLASSICS
3. 16 AWG - 2 CONDUCTOR WIRE RUNS - CEC PROVIDED.
4. G.C. TO MOUNT SW1 & SW2.
5. G.C. TO RUN CABLES AND MAKE CONNECTIONS AS INDICATED ON PLANS.
6. G.C. TO PROVIDE WIRING FROM SW1 TO SW2 TO AV ROOM.
7. SET 'SW' SPEAKERS TO 8 OHMS

ELECTRICAL KEYNOTES

1. 1 RUN SW1 TO AC ROOM LABELED "SUBS", 1 RUN SW1 TO SW2.
2. EACH ZONE TO BE WIRED IN SERIES. THE RUNS WILL GO BACK TO THE SHOW RACK WHERE THEY ARE TO BE LABELED BY ZONE SO INSTALLER CAN IDENTIFY AND TAP INTO THE CORRECT CHANNEL ON THE AMPLIFIER.
3. CABLE AT 18" A.F.F. BEHIND TICKET BLASTER.
4. BLUE CAT 6 AND SHIELDED MICROPHONE WIRE (CEC SUPPLIED) VERIFY WITH CEC.
5. DATA OUTLET MOUNTED TO CEILING. BLACK CAT 6 RUN AT EACH TV TO AV ROOM (CEC PROVIDED) TO FLOOR +10'
6. DATA FOR VIDEO WALL. VERIFY MOUNTING HEIGHT. BLACK CAT 6 RUN AT EACH TV TO AV ROOM (CEC PROVIDED) TO FLOOR +10'
7. PROVIDE DATA PORT FOR FSK EQUIPMENT ROUTED THROUGH POWER POLE.

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE DOCUMENTS, AS THESE ELEMENTS ARE SHOWN ONLY FOR REFERENCE, AND REQUIRE VERIFICATION PRIOR TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.

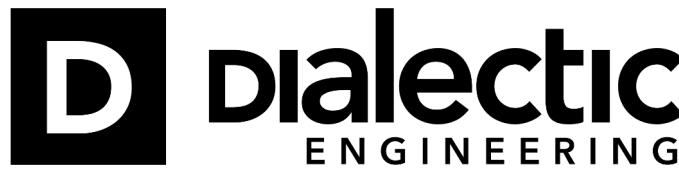

Dialectic, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108

T 816-997-9601
F 816-997-9602
DialecticEng.com

Florida Certificate of
Authorization Number 8039

Date
Copyright 2021



#718

7419 International Dr.
Orlando, FL 32819

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd


Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75267
Ph: 972-221-1979
Contact: Bill Pounds

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997-9627
Contact: Joe Hillebrenner, P.E.

Design Directive: 43

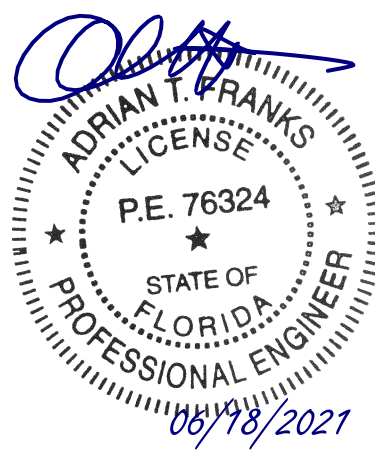

No.	Description	Date
A	PERMIT SET	2021.05.28

DRAWN BY: JGM

CHECKED BY: ATF


PROJ. NO: 94-21751

Copyright Parkway C&A, LP 2020 ©

SPEAKER PLAN

Approved By:
Orange County
Division of Building Safety
B21900424
AV1.0

08/13/21


$$1/8'' = 1'-0''$$

AS	ATLAS SPEAKER (CEILING)
PA	RESTROOM SPEAKER (CEILING)
SW	CEILING SUBWOOFER
— — —	AUDIO
- - - - -	DATA/MONITOR

1	INSTALL NEW ATLAS FAP42T SPEAKERS AT 16'-0" ON CENTER MAX. OR AS INDICATED SET TO 70V. 16W
2	DO NOT INSTALL SPEAKERS OVER THE FOLLOWING: 2A. FURNITURE 2B. SKYTUBES 2C. MERCHANDISE OR POS STATIONS 2D. BEVERAGE BAR 2E. SKEEBALL OR ALLEY ROLLER CLASSICS
3	16 AWG - 2 CONDUCTOR WIRE RUNS - CEC PROVIDED.
4	G.C. TO MOUNT SW1 & SW2.
5	G.C. TO RUN CABLES AND MAKE CONNECTIONS AS INDICATED ON PLANS.
6	G.C. TO PROVIDE WIRING FROM SW1 TO SW2 TO AV ROOM.
7	SET 'SW' SPEAKERS TO 8 OHMS

- 1 1 RUN SW1 TO AC ROOM LABELED "SUBS", 1 RUN SW1 TO SW2.
- 2 EACH ZONE TO BE WIRED IN SERIES. THE RUNS WILL GO BACK TO THE SHOW RACK WHERE THEY ARE TO BE LABELED BY ZONE SO INSTALLER CAN IDENTIFY AND TAP INTO THE CORRECT CHANNEL ON THE AMPLIFIER.
- 3 CABLE AT 18" A.F.F. BEHIND TICKET BLASTER.
- 4 BLUE CAT 6 AND SHIELDED MICROPHONE WIRE (CEC SUPPLIED) VERIFY WITH CEC.
- 5 DATA OUTLET MOUNTED TO CEILING. BLACK CAT 6 RUN AT EACH TV TO AV ROOM (CEC PROVIDED) TO FLOOR +10'
- 6 DATA FOR VIDEO WALL. VERIFY MOUNTING HEIGHT. BLACK CAT 6 RUN AT EACH TV TO AV ROOM (CEC PROVIDED) TO FLOOR +10'
- 7 PROVIDE DATA PORT FOR FSK EQUIPMENT ROUTED THROUGH POWER POLE.

7419 International Dr.
Orlando, FL 32819

Owner

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Bill Pounds

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.

Design Directive: 43


ADRIAN FRANKS
P.E. 76324
STATE OF FLORIDA
PROFESSIONAL ENGINEER

Digitally signed by Adrian Franks
DN:
c=US, o=Florida Professional Engineers Inc,
ou=Professional Engineers, cn=Adrian Franks,
email=adfrank@pefl.com

SIGNATURE VERIFIED BY THE STATE OF FLORIDA
The integrity of the document has been verified.

Date: 2021.07.02 19:26:15 -04'00'

07/02/2021

Adrian Frank

A	PERMIT SET	2021.05.28
No.	Description	Date

DRAWN BY: JGM

CHECKED BY: ATF

PROJ. NO: 94-21751

Copyright Parkway C&A, LP 2020 ©

SPEAKER PLAN

**Approved Plans
Orange County
Division of Building Safety**

AV1.0

08/13/20

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE CONTRACTS. THIS SHEET IS TO BE SHOWN ONLY FOR REFERENCE, AND REQUIRE VERIFICATION PRIOR TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.

D **dialectic**
ENGINEERING

Dialectic, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108

Florida Certificate of
Authorization Number 8039

T 816-997-9601
F 816-997-9602
DialecticEng.com

Copyright 2021

This Approval does not grant permission to violate any applicable code. Encroachment of any part of this improvement can result in a cloud on title of this property. Keep this plan on the job site at all times.

1. CONNECT EXIT SIGNS, EMERGENCY AND NIGHT LIGHTS TO AN UNSWITCHED LIGHTING CIRCUIT, NOT CONTROLLED BY ANY OCCUPANCY SENSORS, SWITCHES OR CONTACTORS.
2. OUTLETS, SWITCHES, AND PLATES SHALL BE:
A) STAINLESS AT FIRE
B) GYREX AT MARLITE. SAFETY RECEPTACLES, LEVITON 5262-SGG RECEPTACLES, 8070-EG PLATE.
C) WHITE AT ALL OTHER AREAS.
D) CEILING OUTLET SHALL BE PAINTED TO MATCH CEILING COLOR.
3. PROVIDE A DEDICATED NEUTRAL, WITH ALL DIMMING SYSTEM CIRCUITS. NO COMMON NEUTRALS SHALL BE ALLOWED.
4. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN AND DETAILS FOR THE LOCATION OF ALL LIGHTING FIXTURES AND ALL OTHER EQUIPMENT INSTALLED IN THE CEILING SYSTEM. VERIFY MOUNTING HEIGHTS AND FINISHES WITH ARCHITECT PRIOR TO ROUGH-IN.
5. REFER TO THE POWER PLANS FOR LOCATIONS OF ELECTRICAL EQUIPMENT

- 1 PROVIDE JUNCTION BOX FOR SIGNAGE TRANSFORMER WITH CODE REQUIRED DISCONNECT, MOUNTED 24" ABOVE FINISHED ROOF. COORDINATE FINAL LOCATIONS AND REQUIREMENTS WITH SIGNAGE VENDOR PRIOR TO ROUGHINS. ALL TRANSFORMERS SHALL BE GROUNDED TO JUNCTION BOX. ROUTE CIRCUIT THROUGH PARAPET WALL. DO NOT PENETRATE ROOF.
- 2 CIRCUIT SHALL BE CONTROLLED THROUGH EXISTING CONTACTOR ACTIVATED BY PHOTOCELL MOUNTED ON THE ROOF AND DEACTIVATED BY A TIME CLOCK.
- 3 CONNECT TO AND REUSE THE EXISTING BRANCH CIRCUIT AND CONTROLS, PROVIDE OCCUPANCY SENSOR FOR RESTROOMS. EC TO VERIFY CIRCUITS ARE NOT OVERLOADED.
- 4 CONNECT TO EXISTING SPARE LIGHTING BRANCH CIRCUIT. ROUTE THROUGH SPARE LIGHTING CONTROL SYSTEM CHANNEL. PROVIDE CONTACTOR IF EXISTING SPARE IS NOT AVAILABLE. CONTRACTOR SHALL VERIFY THE LOAD ON THE BRANCH CIRCUIT WHEN COMPLETE AND REPORT FINDINGS TO THE GEC PM IN WRITING.
- 5 RECEPTACLE AND DATA FOR TV MONITORS SUSPENDED FROM STRUCTURE.
- 6 WEATHER PROOF JUNCTION BOX FOR CONNECTIONS TO EYEBROW FEATURE LIGHT FIXTURES, VERIFY EXACT LOCATION. COORDINATE WITH SIGN MANUFACTURER.
- 7 CONNECT TO EXISTING SPARE CIRCUIT. IF NO SPARE CIRCUITS ARE LEFT PROVIDE A 20A CIRCUIT BREAKER MATCHING EXISTING EQUIPMENT.


$$1/8'' = 1'-0''$$


LIGHTING FIXTURE SCHEDULE							
Type Mark	MANUFACTURER	CATALOG NUMBER	DESCRIPTION	LAMPS	VOLTS	FIXTURE WATTS	REMARKS
DL-02	COMMERCIAL LIGHTING IND.	CLI-CECNADL-02	FLY SUSPENSION LAMP, COLOR: ORANGE; DIM 20.5"D X 13"H; 101" MAX HEIGHT	E26 MEDIUM BASE HALOGEN MAP	120 V	43 VA	MOUNT AT 6' AFF.
L1	COMERCIAL LIGHTING IND.	CLI-CECNADL-01	EXTERIOR WALL SCONCE LED TUBE DOWN OUTDOOR WALL LIGHT, COLOR: BLACK; DIM: 5"L X 7"H X 6" EXTENSION	LED LAMP INCLUDED	120 V	18 VA	LABELLED FOR WET LOCATION

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. OTHER SHEETS INCLUDING SPECIFICATIONS APPLY. THAT SHOWN HEREON IS SCHEMATIC IN NATURE AND NOT TO BE USED AS A SHOP DRAWINGS.

THEREFORE, INCLUDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS AND THE EQUIPMENT AND MATERIALS TO BE USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS AS SHOWN ON THEIR RESPECTIVE DOCUMENTS. THESE ELEMENTS ARE SHOWN FOR REFERENCE AND SHALL BE VERIFIED PRIOR TO CONSTRUCTION AND THE ENGINEER ASSUMES NO LIABILITY FOR THE ACCURACY OF THESE ELEMENTS. NO WARRANTY OR LIABILITY IS ASSUMED FOR ANY PORTION OF THE WORK THAT THE PROFESSIONAL ENGINEER HAS NOT SIGNED AND SEALED PER STATE REQUIREMENTS.

Dialectic

Dialectic, Inc. T 816-997-9601
310 W 20th Street, Suite 200 F 816-997-9602
Kansas City, MO 64108 DialecticEng.com
Florida Certificate of
Authorization Number 8039 Copyright 2019

Per

Copyright 2019 **Dat**


Owner:
CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Bill Pounds

MEP Engineer

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: 816-997-9627
Contact: Joe Hillebrenner, P.E.

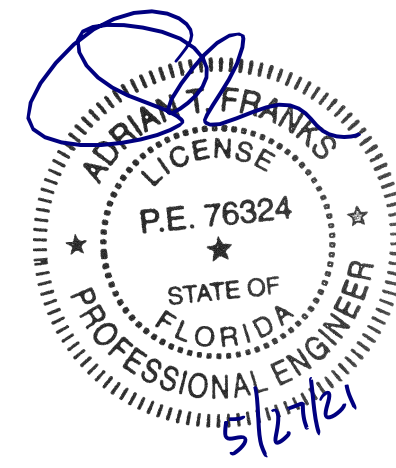

No.	Description	Date
-----	-------------	------

DRAWN BY: JGM

CHECKED BY: ATF

PROJ. NO: 94-21751

Copyright PKWY Architects, LLC 2019 ©

LIGHTING FLOOR PLAN


**Approved Plans
Orange County
Division of Building Safety**

E1.0

08/13/21

This Approval does not grant permission to violate any applicable code.
Encroachment of any part of this improvement can result in a cloud on
title of this property. Keep this plan on the job site at all times.

ELECTRICAL SYMBOLS LEGEND

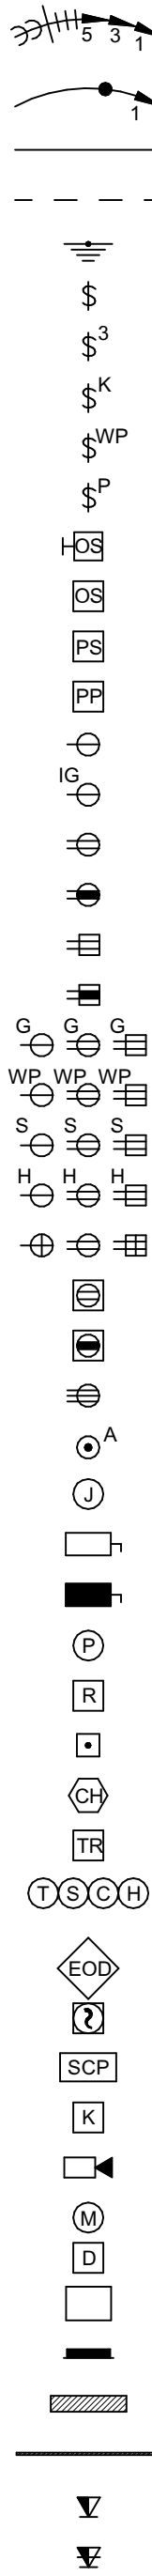

HOME RUN TO PANEL. CIRCUIT NUMBERS, PHASE, NEUTRAL, AND GROUND CONDUCTORS INDICATED ALONG WITH ISOLATED GROUND CONDUCTOR IF APPLICABLE. PARTIAL CIRCUIT.

CONDUIT INSTALLED CONCEALED ABOVE CEILING OR IN WALL.

CONDUIT INSTALLED CONCEALED BELOW FLOOR SLAB OR UNDERGROUND.

GROUND CONNECTION.

SINGLE POLE SWITCH, +3'-10" OR AS NOTED.

THREE-WAY SWITCH, +3'-10" OR AS NOTED.

KEY OPERATED SWITCH, +3'-10" OR AS NOTED.

WEATHERPROOF TOGGLE SWITCH, +3'-10" OR AS NOTED.

SINGLE POLE SWITCH WITH PILOT LIGHT, +3'-10" OR AS NOTED.

WALL MOUNTED OCCUPANCY SENSOR, +3'-10" OR AS NOTED.

CEILING MOUNTED OCCUPANCY SENSOR.

CEILING MOUNTED INTERIOR DAYLIGHT HARVESTING PHOTOCELL SENSOR.

POWER PACK, INSTALLED ABOVE ACCESSIBLE CEILING.

SIMPLEX RECEPTACLE, +18" OR AS NOTED.

ISOLATED GROUND SIMPLEX RECEPTACLE, +18" OR AS NOTED.

DUPLEX RECEPTACLE, +18" OR AS NOTED.

ISOLATED GROUND DUPLEX RECEPTACLE, +18" OR AS NOTED.

QUADRUPLEX RECEPTACLE +18" OR AS NOTED.

ISOLATED GROUND QUADRUPLEX RECEPTACLE, +18" OR AS NOTED.

GROUND FAULT INTERRUPTING RECEPTACLE, +18" OR AS NOTED.

WEATHERPROOF GROUND FAULT INTERRUPTING RECEPTACLE, +18" OR AS NOTED.

SURGE PROTECTED RECEPTACLE, +18" OR AS NOTED.

RECEPTACLE INSTALLED HORIZONTALLY AT +18" OR AS NOTED.

RECEPTACLE INSTALLED HORIZONTALLY, BOTTOM AT +6" ABOVE COUNTER TOP.

RECEPTACLE INSTALLED FLUSH IN CEILING.

ISOLATED GROUND RECEPTACLE INSTALLED FLUSH IN CEILING.

SPECIAL RECEPTACLE, NEMA STYLE AS NOTED, +18" OR AS NOTED.

FLUSH FLOOR MOUNTED RECEPTACLE, LETTER INDICATES TYPE.

JUNCTION BOX.

DISCONNECT SWITCH, TOP AT +6'-0" OR AS NOTED.

DISCONNECT SWITCH PROVIDED WITH EQUIPMENT.

EXTERIOR PHOTOCELL, INSTALLED ON ROOF FACING NORTH.

CONTROL OR POWER RELAY, INSTALLED AS NOTED.

PUSHBUTTON, TOP AT +4'-6" OR AS NOTED.

DOOR BELL CHIMEM, +8'-0" OR AS NOTED.

CONTROL TRANSFORMER, INSTALLED AS NOTED.

THERMOSTAT, TEMPERATURE SENSOR, CARBON DIOXIDE SENSOR AND HUMIDISTAT PROVIDED BY MECHANICAL CONTRACTOR, +3'-10" OR AS NOTED.

ELECTRICALLY OPERATED DAMPER, PROVIDED BY MECHANICAL CONTRACTOR.

120 VOLT DUCT TYPE SMOKE DETECTOR, PROVIDED BY MECHANICAL CONTRACTOR.

SECURITY SYSTEM CONTROL PANEL, TOP AT +6'-0".

KEYPAD, +46" OR AS NOTED.

SECURITY CAMERA.

MOTION DETECTOR, CEILING MOUNTED.

DOOR CONTACTS.

TRANSFORMER, FLOOR MOUNTED OR SUSPENDED FROM STRUCTURE AS NOTED.

BRANCH CIRCUIT PANELBOARD, TOP AT +6'-0" OR AS NOTED.

DISTRIBUTION PANEL, TOP AT +6'-0" OR AS NOTED.

PLYWOOD PHONEBOARD, INSTALLED AS NOTED.

TELEPHONE/DATA OUTLET, +18" WITH 1" CONDUIT TO ABOVE CEILING.

TELEPHONE/DATA OUTLET, +6" WITH ABOVE COUNTER WITH 1" CONDUIT TO ABOVE CEILING.

GENERAL REFERENCES/NOTATIONS:

AC	MOUNT DEVICE +6" ABOVE TOP OF COUNTER TO BOTTOM OF DEVICE.
+48"	MOUNTING HEIGHT ABOVE FINISHED FLOOR TO CENTERLINE OF DEVICE.
03/E5	DETAIL OR SECTION REFERENCE.
???	FOODSERVICE EQUIPMENT DESIGNATION.
#	REVISION DESIGNATION.
TYP ?	EQUIPMENT DESIGNATION.

ABBREVIATIONS:

AFI/AFG	ABOVE FINISHED FLOOR/GRADE.	NEC	NATIONAL ELECTRICAL CODE.
AHJ	AUTHORITY HAVING JURISDICTION.	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION.
BAS	BUILDING AUTOMATION SYSTEM.	NL	NIGHT LIGHT.
DNR	DEPARTMENT OF NATURAL RESOURCES.	NF	NON-FUSED.
EC	ELECTRICAL CONTRACTOR.	PA	PUBLIC ADDRESS.
EM	EMERGENCY.	PC	PLUMBING CONTRACTOR.
ETR	EXISTING TO REMAIN.	SPD	SURGE PROTECTION DEVICE.
FA	FIRE ALARM.	TYP	TYPICAL.
FPC	FIRE PROTECTION CONTRACTOR.	UL	UNDERWRITERS LABORATORIES.
FSEC	FOOD SERVICE EQUIPMENT CONTRACTOR.	UNO	UNLESS NOTED OTHERWISE.
GC	GENERAL CONTRACTOR.	UPS	UNINTERRUPTIBLE POWER SUPPLY.
MC	MECHANICAL CONTRACTOR.	WP	WEATHERPROOF.

- SYMBOL & LEGEND NOTES:
1. REFER TO LIGHT FIXTURE SCHEDULE FOR SPECIFICATION AND INFORMATION ON ALL LUMINAIRES.
 2. REFER TO SPECIFICATIONS AND PLAN NOTES FOR DETAILED DESCRIPTION OF ALL DEVICES SHOWN IN THIS SCHEDULE, PROVIDED BY THIS CONTRACTOR.
 3. MOUNTING HEIGHTS INDICATED ARE MEASURED FROM FINISHED FLOOR TO THE CENTERLINE OF THE DEVICE UNLESS NOTED OTHERWISE.

ELECTRICAL GENERAL NOTES

- 1 INCLUDE ALLOWANCE FOR UNFORSEEN CONDITIONS THAT MAY EFFECT THE SCOPE OF WORK. MINOR DEVIATIONS REQUIRED FOR ACCOMPLISHING THE INTENT OF THIS DESIGN ARE TO BE INCLUDED IN THIS ALLOWANCE.
- 2 ELECTRICAL DESIGN HAS BEEN BASED ON THE INSTALLATION OF 75°C CONDUCTORS CONNECTED TO TERMINAL LUGS AND EQUIPMENT U.L. LISTED FOR A MINIMUM 75°C CONDUCTORS TERMINATED ON EQUIPMENT WITH A LOWER RATING 60°C) OR NO RATING SHOWN TO HAVE CONDUCTOR SIZE INCREASED TO CONFORM TO ADOPTED ELECTRICAL CODE AND UL/CUL NO. 489 REQUIREMENTS.
- 3 CONDUIT INSTALLED INDOORS SHALL BE ELECTRICAL METALLIC TUBING (EMT), MINIMUM 1/2" OR AS NOTED.
- 4 CONDUIT INSTALLED BELOW SLAB SHALL BE RIGID STEEL, IMC, PVC OR HDPE. MINIMUM 3/4". IF PVC OR HDPE IS USED, TRANSITION TO RIGID STEEL BEFORE TURNING UP AND PENETRATING FLOOR SLAB.
- 5 CONDUCTORS SHALL BE A MINIMUM OF #12 THHN/THWN COPPER UNLESS NOTED OTHERWISE ON PLANS OR IN SPECIFICATIONS. BRANCH CIRCUITS SHALL BE PROVIDED WITH (2) #12 CONDUCTORS AND (1) #12 EQUIPMENT GROUND CONDUCTOR UNLESS NOTED OTHERWISE.
- 6 BRANCH CIRCUITS SHOWN WITH TWO GROUNDING CONDUCTORS SHALL HAVE ONE EQUIPMENT GROUND CONDUCTOR (GREEN) AND ONE ISOLATED GROUND CONDUCTOR (GREEN W/ YELLOW STRIP) INSTALLED IN RACEWAY.
- 7 DIRECT CURRENT WIRING SHALL BE (2) #10 IN 1/2" CONDUIT UNLESS NOTED OTHERWISE.
- 8 CONTROL VOLTAGE WIRING SHALL BE PLENUM RATED OR INSTALLED IN CONDUIT.
- 9 PROVIDE FLEXIBLE CONNECTIONS ONLY FOR FINAL CONNECTION TO EQUIPMENT, 6'-0" MAXIMUM LENGTH. PROVIDE LIQUID TIGHT FLEXIBLE EQUIPMENT, 6'-0" MAXIMUM LENGTH. PROVIDE LIQUID TIGHT FLEXIBLE CONNECTION AT EXTERIOR LOCATIONS AND WHERE EXPOSURE TO MOISTURE IS POSSIBLE.
- 10 ALL EMPTY CONDUITS SHALL BE PROVIDED WITH A PULL WIRE.
- 11 ALL RACEWAYS SHALL CONTAIN A GROUNDING ELECTRODE SIZED PER THE ADOPTED ELECTRICAL CODE.
- 12 COORDINATE WORK ABOVE THE CEILING WITH OTHER TRADES TO PROVIDE THE GREATEST POSSIBLE CLEARANCE. CONDUIT RUNS SHALL BE RUN THROUGH TRUSSES WHERE POSSIBLE.
- 13 VERIFY EXACT PLACEMENT OF ALL DEVICES SHOWN ON THE CONSTRUCTION DOCUMENTS PRIOR TO FINAL PLACEMENT.
- 14 ALL PANELBOARDS, SWITCHBOARDS AND LINE VOLTAGE CONTROL EQUIPMENT SHALL BE FIELD MARKED TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS. MARKING SHALL BE LOCATED SO AS TO BE CLEARLY VISIBLE TO QUALIFIED PERSONS BEFORE EXAMINATION, ADJUSTING, SERVICING OR MAINTENANCE OF EQUIPMENT. MARKING SHALL BE SLEF ADHESIVE, COMMERCIAL LABEL CONFORMING TO ADOPTED CODES.
- 15 LIGHT SWITCHES, ELECTRICAL OUTLETS, THERMOSTATS AND OTHER ENVIRONMENTAL CONTROLS LOCATED NO HIGHER THAN 48" AND NO LOWER THAN 15" ABOVE THE FLOOR. IF THE REACH IS OVER AN OBSTRUCTION BETWEEN 20" AND 25" IN DEPTH, THE MAXIMUM HEIGHT IS TO BE REDUCED TO 44" FOR FORWARD APPROACH OR 48" FOR SIDE APPROACH. PROVIDED THE OBSTRUCTION IS NO MORE THAN 24" IN DEPTH. OBSTRUCTIONS SHALL NOT EXTEND MORE THAN 25" FROM THE WALL BENEATH A CONTROL.
- 16 TERMS: SHALL - ACTION THAT IS REQUIRED WITHOUT OPTION OR QUALIFICATION. FURNISH - CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING. INSTALL - CONTRACTOR SHALL BE RESPONSIBLE FOR LABOR AND CONSTRUCTION EQUIPMENT NECESSARY TO SET IN PLACE, CONNECT, CALIBRATE AND/OR TEST EQUIPMENT FURNISHED BY HIM OR OTHERS. PROVIDE - CONTRACTOR SHALL FURNISH AND INSTALL.

REMODEL GENERAL NOTES

- 1 ALL EXISTING EQUIPMENT, WIRING DEVICES, LIGHTS, CONDUIT, WIRING, CIRCUITING, ETC., NOT DISTURBED BY NEW CONSTRUCTION WORK SHALL BE MAINTAINED AND UNDAMAGED. THESE DEVICES, IF SHOWN, ARE SHOWN FOR INFORMATION PURPOSES ONLY. VISIT THE JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND FAMILIARIZE THEMSELVES WITH ALL WORK TO BE DONE AT THE JOB SITE. FAILURE TO DO SO SHALL NOT RELIEVE CONTRACTOR OF THE RESPONSIBILITY FOR PERFORMING ALL WORK NECESSARY TO PROVIDE A WORKMANLIKE INSTALLATION.
- 2 EXISTING SERVICES (ELECTRICAL, FIRE ALARM, ETC.) SHALL NOT BE INTERRUPTED WITHOUT PRIOR SCHEDULING OF SUCH OUTAGES WITH THE OWNER, ARCHITECT, AND ALL OTHER PARTIES INVOLVED.
- 3 MAINTAIN ACCURATE RECORDS OF ALL MODIFICATIONS TO EXISTING SYSTEMS WHICH ARE TO REMAIN. DELIVER ALL "RECORD" DRAWINGS TO THE OWNER INDICATING SUCH CHANGES.
- 4 DISCONNECT AND LABEL ABANDONED FEEDERS AND CIRCUITS.
- 5 REMOVE ALL EXPOSED CONDUITS, CONDUITS ABOVE LAY-IN CEILINGS, OR EQUIPMENT WHICH IS ABANDONED.
- 6 WHERE NEW WORK INTERFERES WITH CIRCUITS IN ROOMS OTHERWISE UNDISTURBED, EXISTING CIRCUITS SHALL BE REWORKED AS REQUIRED TO MAINTAIN SERVICE.
- 7 ALL EQUIPMENT, FIXTURES, PANELBOARDS, CONDUIT AND WIRING THAT ARE REMOVED SHALL BE REMOVED FROM THE JOB SITE, UNLESS DIRECTED OTHERWISE BY THE ARCHITECT OR OWNER'S REPRESENTATIVE.
- 8 EXISTING ROUGH-IN BOXES AND CONDUIT MAY BE UTILIZED IF THEY ARE OF PROPER SIZE AND IN SUITABLE LOCATION(S) FOR NEW CONSTRUCTION. DEVICES AND WIRING SHALL BE NEW.
- 9 CIRCUIT ROUTINGS SHOWN IN REMODELED AREAS MAY BE MODIFIED TO SUIT FIELD CONDITIONS. KEEP DEVICES AND/OR FIXTURE CIRCUITS APPROXIMATELY AS INDICATED TO LIMIT VOLTAGE DROP OF FEEDER AND BRANCH CIRCUITS.
- 10 VERIFY THE LOCATION AND CONDITION OF ALL EXISTING UTILITIES AND PROTECT DURING THE COURSE OF THEIR WORK. EXISTING UTILITIES, BUILDING MATERIALS AND ANY ASSOCIATED ITEMS WHICH ARE DAMAGED BY CONTRACTOR'S NEGLIGENCE SHALL BE REPAIRED OR REPLACED AT THE CONTRACTOR'S EXPENSE (IN A TIMELY MANNER) AND TO THE OWNER'S APPROVAL.
- 11 COORDINATE THE REMOVAL OR RELOCATION OF ALL MECHANICAL AND PLUMBING EQUIPMENT. DISCONNECT AND REMOVE ALL ELECTRICAL POWER AND CONTROL CIRCUITS FOR EQUIPMENT BEING REMOVED OR RELOCATED. EXISTING CONDUIT AND ROUGH-IN MAYBE USED FOR RELOCATED OR NEW EQUIPMENT. ALL CONDUCTORS SHALL BE NEW.
- 12 REMOVE ALL EXISTING DATA, TELEPHONE, FIRE ALARM CABLING AND ANY OTHER LOW VOLTAGE WIRING THAT ARE NOT TO BE USED.
- 13 DESIGN IS BASED ON FIELD INFORMATION, AS-BUILT DRAWINGS AND OWNER FURNISHED INFORMATION. VERIFY ACCURACY OF ALL EXISTING CONDITIONS. IN CASE OF DISCREPANCY, PROVIDE ALL NECESSARY CONDUIT, WIRE, BOXES, FITTINGS, ETC. FOR A COMPLETE OPERATING ELECTRICAL SYSTEM. ENTIRE INSTALLATION TO COMPLY WITH SPECIFICATIONS AND ADOPTED ELECTRICAL CODE.

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE DOCUMENTS, AS THESE ELEMENTS ARE SHOWN ONLY FOR REFERENCE, AND REQUIRE VERIFICATION PRIOR TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.



Dialectic, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108

T 816-997-9601
F 816-997-9602
DialecticEng.com

Florida Certificate of
Authorization Number 8039

Date
Copyright 2021



#718

7419 International Dr.
Orlando, FL 32819

Owner:

CEC ENTERTAINMENT, INC.,
1707 Market Place Blvd, Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd


Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Bill Pounds

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997-9627
Contact: Joe Hillebrenner, P.E.

Design Directive: 43

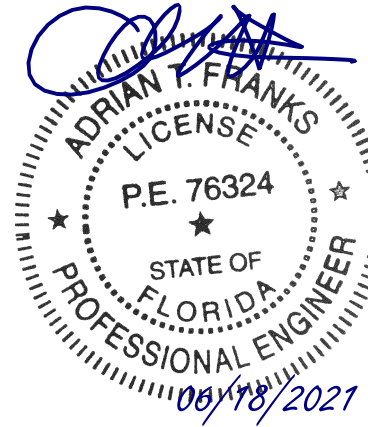

A	PERMIT SET	2021.05.28
No.	Description	Date

DRAWN BY: JGM

CHECKED BY: ATF

PROJ. NO: 94-21751

Copyright Parkway C&A, LP 2020 ©

LEGEND & KEYNOTES

Approved By:
Orange County
Division of Building Safety

B2190302

E0.0


08/13/21

1	ALL OUTLETS ACCESSIBLE TO PUBLIC SHALL BE TAMPER RESISTANT.
2	OUTLETS SHALL BE CONCEALED FROM PUBLIC AND LOCATED BEHIND EQUIPMENT
3	REFER TO SHEET A1.2 FOR FLOOR RECEPTACLE LOCATIONS.
4	ELECTRICAL CONTRACTOR TO FIELD VERIFY ALL CIRCUIT REQUIREMENTS WITH OWNER AND EXISTING SPANEL PANEL SPACE IS AVAILABLE IN PANELS
5	ELECTRICAL CONTRACTOR TO FIELD VERIFY WORKING ORDER AND QUANTITY OF EXISTING CIRCUITS SERVING GAMES.
6	CONFIGURATION OF 12X12X2" DANCE FLOOR RESESSOR BOX MAY VARY PER LOCATION. VERIFY EXACT CONDITIONS WITH OWNER PRIOR TO ROUGH-IN.

1 CONTRACTOR SHALL PROVIDE BID TO INSTALL UNDER CARPET WIRING SYSTEM FOR POWER DISTRIBUTION TO ARCADE GAMES. SYSTEM SHALL COMPLY WITH NEC REQUIREMENTS AND BE AS PROVIDED BY TYCO/AMP SYSTEMS. CONTACT SARAH MAKE: (817) 213 1533, Sarah.Moake@gmail.com FOR INFORMATION AND QUANTITIES OF FCC AND CABLERIES FOR UNDER CARPET WIRING INSTALLATION.

2 INSTALLATION, CABLE/FLOOR PREPARATION SHALL BE REQUIRED FOR PROPER INSTALLATION. E.G. FLOOR PREPARATION, TOP SHIELD, ADHESIVE, H.D DOWN PATE, PATCHING, BONDING CLIPS, ETC. COORDINATE WITH MANUFACTURERS RECOMMENDED INSTALLATION TECHNIQUES AND ACTUAL FIELD CONDITIONS. PROVIDE AS NEEDED.

- 1 TYCO/AMP UNDER CARPET WIRING SYSTEM CABLE ROUTE. INSTALL PER MANUFACTURERS RECOMMENDATIONS AND REQUIREMENTS. SEE DETAIL "1" ON SHEET E3.0.
- 2 TYCO/AMP UNDER CARPET WIRING SYSTEM ACTIVATION AND OUTLET BOX. INSTALL PER MANUFACTURERS RECOMMENDATIONS AND REQUIREMENTS. VERIFY WITH PROJECT MANAGER ANY FINAL CHANGE TO GAME LAYOUT PRIOR TO INSTALLING. DETAIL "2" ON SHEET E3.0.
- 3 PROVIDE FULLY RECESSED TRANSITION BOX FOR UNDER CARPET WIRING SYSTEM CONNECTION. SEE DETAIL "3" ON SHEET E3.0.
- 4 PROVIDE DUPLEX RECEPTACLE WITH TWO(2) INTEGRAL USB CHARGING PORT AT EACH RECEPTACLE. MOUNT DEVICE HORIZONTALLY ALONG DIMENSION MOUNT BETWEEN INSTALL MC CABLE OR FLEX CONDUIT IN FURNITURE/HOLLOW SPACE @ BOTH SITES. VERIFY REQUIREMENTS IN FIELD.
- 5 GC FURNISHED 12"x12"x6" BOX RECESSED INTO FLOOR. (1) QUAD RECEPTACLE SP TO RECEIVE (4) DEDICATED 20A CIRCUIT AND (1) DUPLEX RECEPTACLE TO RECEIVE (1) DEDICATED 20A CIRCUIT. (2) YELLOW CAT6 CABLES STUBBED INTO BOX.
- 6 (2) YELLOW CAT6 CABLES FROM FLOOR BOX TO AV ROOM WITH 12' OF SLACK. YELLOW CAT6 PROVIDED BY CEC AND INSTALLED BY GC
- 7 EXTEND 1" CONDUIT TO ABOVE ACCESSIBLE CEILING SPACE WITH (2)YELLOW CAT6 BACK TO AV ROOM. YELLOW CAT6 FURNISHED BY CEC.
- 8 SATIN ANODIZED ALUMINUM, 10' TELE-POWER POLE WITH TWO SEPARATE WIRING COMPARTMENTS. ONE COMPARTMENT FOR POWER WIRING WITH TWO DUPLEX, 20A, 125 VOLT RECEPTACLES IN COVER FACE AND POWER JUNCTION BOX FOR SECOND COMPARTMENT FOR COMMUNICATION WIRING WITH REMOVABLE COVER SECTION AT BOTTOM OF POLE FOR CABLE ACCESS. WIREMID#MDPT4.
- 9 GAMES IN THIS LOCATION REQUIRE A DEDICATED 20A, 120V CONNECTION.
- 10 USE DUPLEX INSTALLED AT SETTEES BY MILLWORK SUPPLIER. GC TO DAISY-CHAIN POWER TO J-BOX.
- 11 RECEPTACLES FOR VIDEO WALL. VERIFY MOUNTING HEIGHT WITH ARCHITECTURAL ELEVATIONS.
- 12 PROVIDE FINAL CONNECTIONS TO STRUCTURE HUNG "YOU WON" SIGN. VERIFY LOCATION WITH ARCHITECT.
- 13 PROVIDE RECESSED RECEPTACLES FOR PROMO BOARD. VERIFY MOUNTING HEIGHT WITH ARCHITECTURAL ELEVATIONS.
- 14 RE-USE EXISTING GAME CIRCUIT
- 15 CONNECT TO EXISTING SPARE CIRCUIT. IF NO SPARE CIRCUITS ARE LEFT PROVIDE 20A CIRCUIT BREAKER MATCHING EXISTING EQUIPMENT.
- 16 TIE INTO NEAREST GAMES FLOOR LIGHTING CIRCUIT. VERIFY CIRCUIT HAS ENOUGH SPARE CAPACITY FOR NEW FLOOR.
- 17 TIE INTO NEAREST CIRCUIT. VERIFY CIRCUIT HAS ENOUGH SPARE CAPACITY FOR FLOOR.

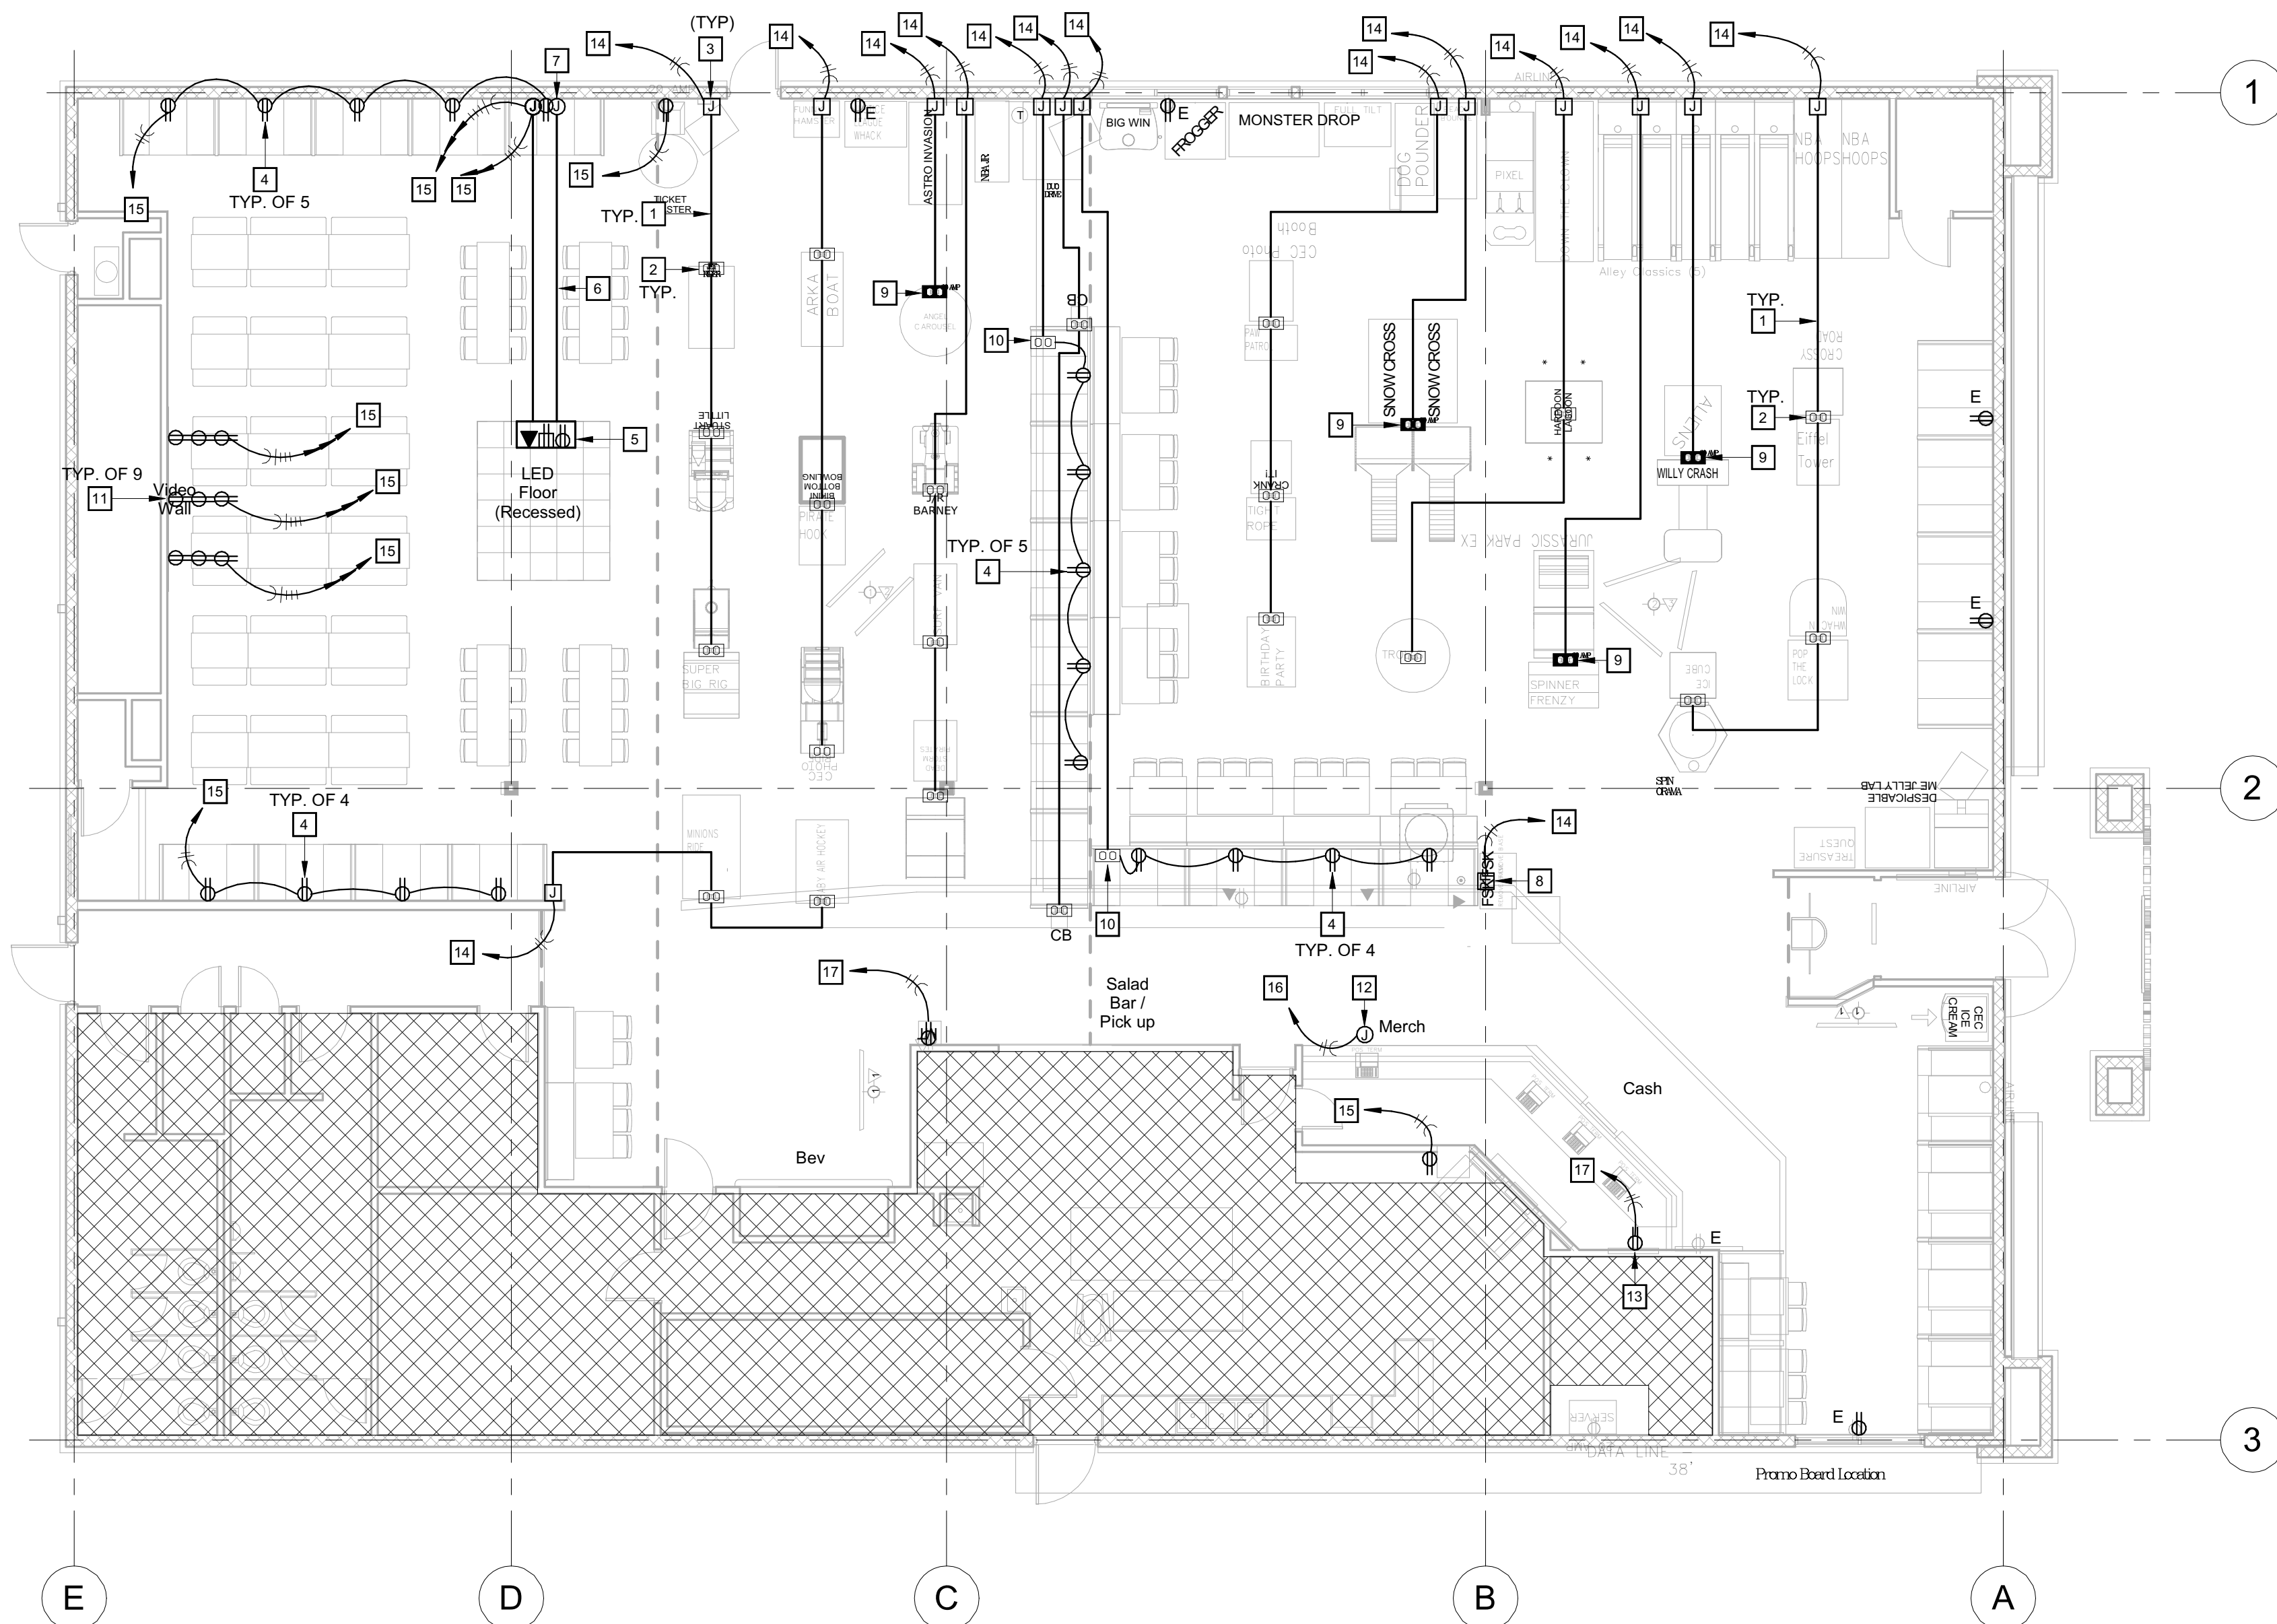
$$1/8" = 1'-0"$$

1

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. OTHER SHEETS INCLUDING SPECIFICATIONS APPLY. THAT SHOWN HEREON IS SCHEMATIC IN NATURE AND NOT TO BE USED AS A SHOP DRAWINGS. THEREFORE, INCLUDE ALL MODIFICATIONS REQUIRED TO CONFORM TO THE SPECIFICATIONS AND THE ENGINEER AND MATERIALS USED. VERIFY FACTORS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS AS SHOWN ON THEIR RESPECTIVE DOCUMENTS. THESE ELEMENTS ARE SHOWN FOR REFERENCE AND SHALL BE VERIFIED PRIOR TO CONSTRUCTION AND THE ENGINEER ASSUMES NO LIABILITY FOR THE ACCURACY OF THESE ELEMENTS. NO DESIGN RESPONSIBILITY IS ASSUMED FOR ANY PORTION OF THE WORK THAT THE PROFESSIONAL ENGINEER HAS NOT SIGNED AND SEALED PER STATE REQUIREMENTS.

Dialectic

Dialectic, Inc. T 816-997-9601
310 W 20th Street, Suite 200 F 816-997-9602
Kansas City, MO 64108 DialecticEng.com
Florida Certificate of
Authorization Number 8039 Copyright 2019

Copyright 2019 **Dat**

PKWY
PKWY Architects, LLC
1000 Civic Circle Lewisville, TX 75067
parkwayconstruction.com (972) 221-1979



#718

7419 International Dr.
Orlando, FL 32819


Owner:
CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Bill Pounds

MEP Engineer

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: 816-997-9627
Contact: Joe Hillebrenner, P.E.

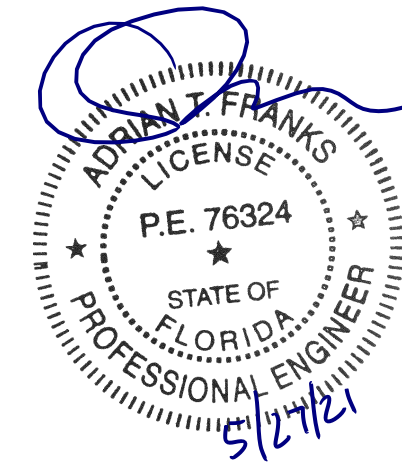

No.	Description	Date
-----	-------------	------

DRAWN BY: JGM

CHECKED BY: ATF

PROJ. NO: 94-21751

Copyright PKWY Architects, LLC 2019 ©

POWER FLOOR PLAN

**Approved Plans
Orange County
Division of Building Safety**

E2.0

08/13/20


This Approval does not grant permission to violate any applicable code.
Encroachment of any part of this improvement can result in a cloud on
title of this property. Keep this plan on the job site at all times.

LIGHTING GENERAL NOTES

- CONNECT EXIT SIGNS, EMERGENCY AND NIGHT LIGHTS TO AN UNSWITCHED LIGHTING CIRCUIT. NOT CONTROLLED BY ANY OCCUPANCY SENSORS, SWITCHES OR CONTACTORS.
- OUTLETS, SWITCHES, AND PLATES SHALL BE:
A) STAINLESS AT FRP
B) GREY AT MARLITE. SAFETY RECEPTACLES, LEVITON 5262-SGG RECEPTACLES, 80703 EG PLATE.
C) WHITE AT ALL OTHER AREAS.
D) CEILING OUTLET SHALL BE PAINTED TO MATCH CEILING COLOR.
- PROVIDE A DEDICATED NEUTRAL WITH ALL DIMMING SYSTEM CIRCUITS. NO COMMON NEUTRALS SHALL BE ALLOWED.
- REFER TO ARCHITECTURAL REFLECTED CEILING PLAN AND DETAILS FOR THE LOCATION OF ALL LIGHTING FIXTURES AND ALL OTHER EQUIPMENT INSTALLED IN THE CEILING SYSTEM. VERIFY MOUNTING HEIGHTS AND FINISHES WITH ARCHITECT PRIOR TO ROUGH-IN.
- REFER TO THE POWER PLANS FOR LOCATIONS OF ELECTRICAL EQUIPMENT

ELECTRICAL KEYNOTES

- PROVIDE JUNCTION BOX FOR SIGNAGE TRANSFORMER WITH CODE REQUIRED DISCONNECT. MOUNTED 24" ABOVE FINISHED ROOF. COORDINATE FINAL LOCATIONS AND REQUIREMENTS WITH SIGNAGE VENDOR PRIOR TO ROUGH-IN. ALL TRANSFORMERS SHALL BE GROUNDED TO JUNCTION BOX. ROUTE CIRCUIT THROUGH PARAPET WALL. DO NOT PENETRATE ROOF.
- CIRCUIT SHALL BE CONTROLLED THROUGH EXISTING CONTACTOR ACTIVATED BY PHOTOCELL MOUNTED ON THE ROOF AND DEACTIVATED BY A TIME CLOCK.
- CONNECT TO AND REUSE THE EXISTING BRANCH CIRCUIT AND CONTROLS. PROVIDE OCCUPANCY SENSOR FOR RESTROOMS. EC TO VERIFY CIRCUITS ARE NOT OVERLOADED.
- CONNECT TO EXISTING SPARE LIGHTING BRANCH CIRCUIT. ROUTE THROUGH SPARE LIGHTING CONTROL SYSTEM CHANNEL. PROVIDE CONTACTOR IF EXISTING SPARE IS NOT AVAILABLE. CONTRACTOR SHALL VERIFY THE LOAD ON THE BRANCH CIRCUIT WHEN COMPLETE AND REPORT FINDINGS TO THE CEC PM IN WRITING.
- RECEPTACLE AND DATA FOR TV MONITORS SUSPENDED FROM STRUCTURE.
- WEATHER PROOF JUNCTION BOX FOR CONNECTIONS TO EYEBROW FEATURE LIGHT FIXTURES. VERIFY EXACT LOCATION. COORDINATE WITH SIGN MANUFACTURER.
- CONNECT TO EXISTING SPARE CIRCUIT. IF NO SPARE CIRCUITS ARE LEFT PROVIDE A 20A CIRCUIT BREAKER MATCHING EXISTING EQUIPMENT.

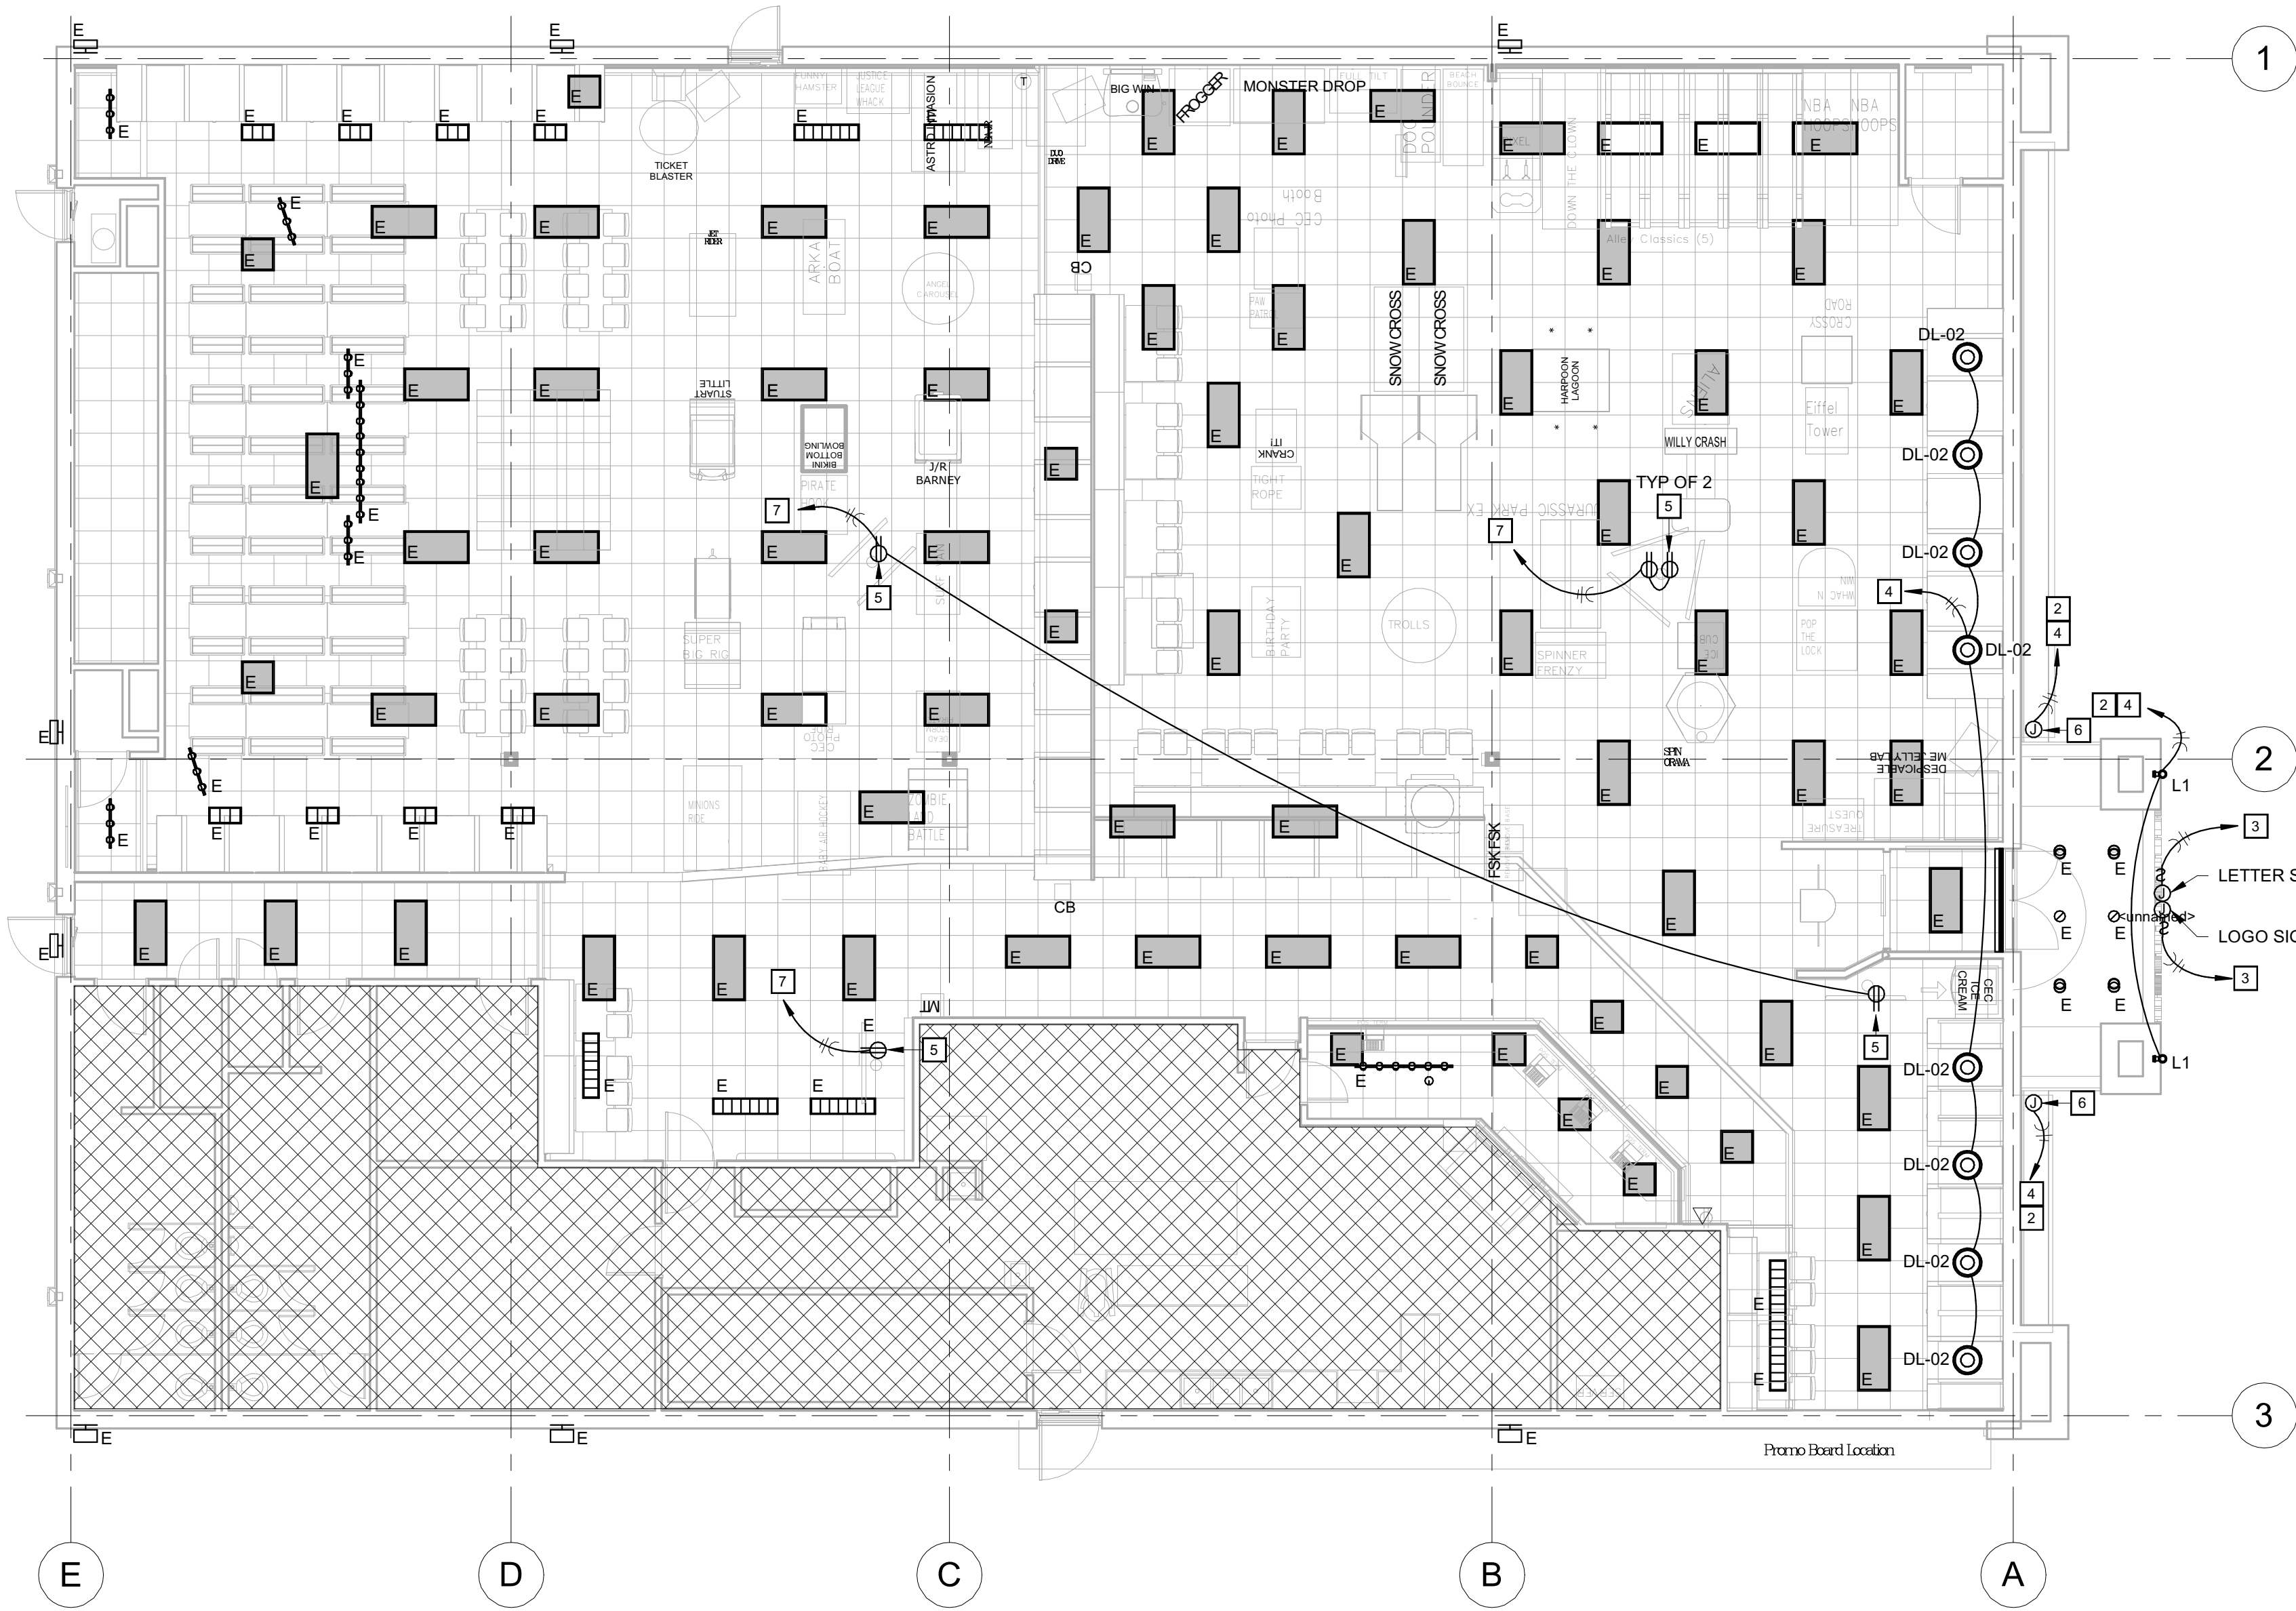

1 LIGHTING FLOOR PLAN


1/8" = 1'-0"



LIGHTING FIXTURE SCHEDULE

Type Mark	MANUFACTURER	CATALOG NUMBER	DESCRIPTION	LAMPS	VOLTS	FIXTURE WATTS	REMARKS
DL-02	COMMERCIAL LIGHTING IND.	CLI-CECNADL-02	FLY SUSPENSION LAMP COLOR: ORANGE; DIM 20.5"D X 13"H; 10" MAX HEIGHT	E26 MEDIUM BASE HALOGEN MAP	120 V	43 VA	MOUNT AT 6' AFF.
L1	COMMERCIAL LIGHTING IND.	CLI-CECNADL-01	EXTERIOR WALL SCONCE LED TUBE DOWN OUTDOOR WALL LIGHT. COLOR: BLACK; DIM. 5"L X 7"H X 6" EXTENSION	LED LAMP INCLUDED	120 V	18 VA	Labeled for WET LOCATION

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE DOCUMENTS, AS THESE ELEMENTS ARE SHOWN ONLY FOR REFERENCE, AND REQUIRE VERIFICATION PRIOR TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.

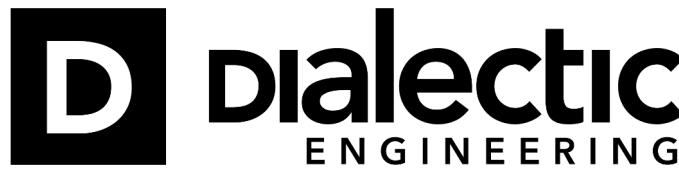

Dialectic, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108

T 816-997-9601
F 816-997-9602
DialecticEng.com

Florida Certificate of
Authorization Number 8039

Date
Copyright 2021



#718

7419 International Dr.
Orlando, FL 32819

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd


Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Bill Pounds

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997-9627
Contact: Joe Hillebrenner, P.E.

Design Directive: 43

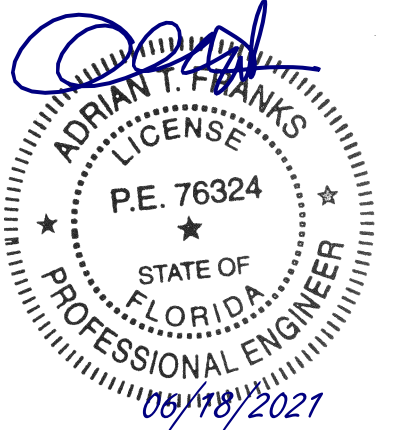

A	PERMIT SET	2021.05.28
No.	Description	Date

DRAWN BY: JGM

CHECKED BY: ATF

PROJ. NO: 94-21751

Copyright Parkway C&A, LP 2020 ©

LIGHTING FLOOR PLAN

Approved By:
Orange County
Division of Building Safety

B2190302

E1.0


08/13/21

LIGHTING GENERAL NOTES

- CONNECT EXIT SIGNS, EMERGENCY AND NIGHT LIGHTS TO AN UNSWITCHED LIGHTING CIRCUIT. NOT CONTROLLED BY ANY OCCUPANCY SENSORS, SWITCHES OR CONTACTORS.
- OUTLETS, SWITCHES, AND PLATES SHALL BE:
A) STAINLESS AT FRP
B) GREY AT MARLITE. SAFETY RECEPTACLES, LEVITON 5262-SGG RECEPTACLES, 80703 EG PLATE.
C) WHITE AT ALL OTHER AREAS.
D) CEILING OUTLET SHALL BE PAINTED TO MATCH CEILING COLOR.
- PROVIDE A DEDICATED NEUTRAL WITH ALL DIMMING SYSTEM CIRCUITS. NO COMMON NEUTRALS SHALL BE ALLOWED.
- REFER TO ARCHITECTURAL REFLECTED CEILING PLAN AND DETAILS FOR THE LOCATION OF ALL LIGHTING FIXTURES AND ALL OTHER EQUIPMENT INSTALLED IN THE CEILING SYSTEM. VERIFY MOUNTING HEIGHTS AND FINISHES WITH ARCHITECT PRIOR TO ROUGH-IN.
- REFER TO THE POWER PLANS FOR LOCATIONS OF ELECTRICAL EQUIPMENT

ELECTRICAL KEYNOTES

- PROVIDE JUNCTION BOX FOR SIGNAGE TRANSFORMER WITH CODE REQUIRED DISCONNECT. MOUNTED 24" ABOVE FINISHED ROOF. COORDINATE FINAL LOCATIONS AND REQUIREMENTS WITH SIGNAGE VENDOR PRIOR TO ROUGH-IN. ALL TRANSFORMERS SHALL BE GROUNDED TO JUNCTION BOX. ROUTE CIRCUIT THROUGH PARAPET WALL. DO NOT PENETRATE ROOF.
- CIRCUIT SHALL BE CONTROLLED THROUGH EXISTING CONTACTOR ACTIVATED BY PHOTOCELL MOUNTED ON THE ROOF AND DEACTIVATED BY A TIME CLOCK.
- CONNECT TO AND REUSE THE EXISTING BRANCH CIRCUIT AND CONTROLS. PROVIDE OCCUPANCY SENSOR FOR RESTROOMS. EC TO VERIFY CIRCUITS ARE NOT OVERLOADED.
- CONNECT TO EXISTING SPARE LIGHTING BRANCH CIRCUIT. ROUTE THROUGH SPARE LIGHTING CONTROL SYSTEM CHANNEL. PROVIDE CONTACTOR IF EXISTING SPARE IS NOT AVAILABLE. CONTRACTOR SHALL VERIFY THE LOAD ON THE BRANCH CIRCUIT WHEN COMPLETE AND REPORT FINDINGS TO THE CEC PM IN WRITING.
- RECEPTACLE AND DATA FOR TV MONITORS SUSPENDED FROM STRUCTURE.
- WEATHER PROOF JUNCTION BOX FOR CONNECTIONS TO EYEBROW FEATURE LIGHT FIXTURES. VERIFY EXACT LOCATION. COORDINATE WITH SIGN MANUFACTURER.
- CONNECT TO EXISTING SPARE CIRCUIT. IF NO SPARE CIRCUITS ARE LEFT PROVIDE A 20A CIRCUIT BREAKER MATCHING EXISTING EQUIPMENT.

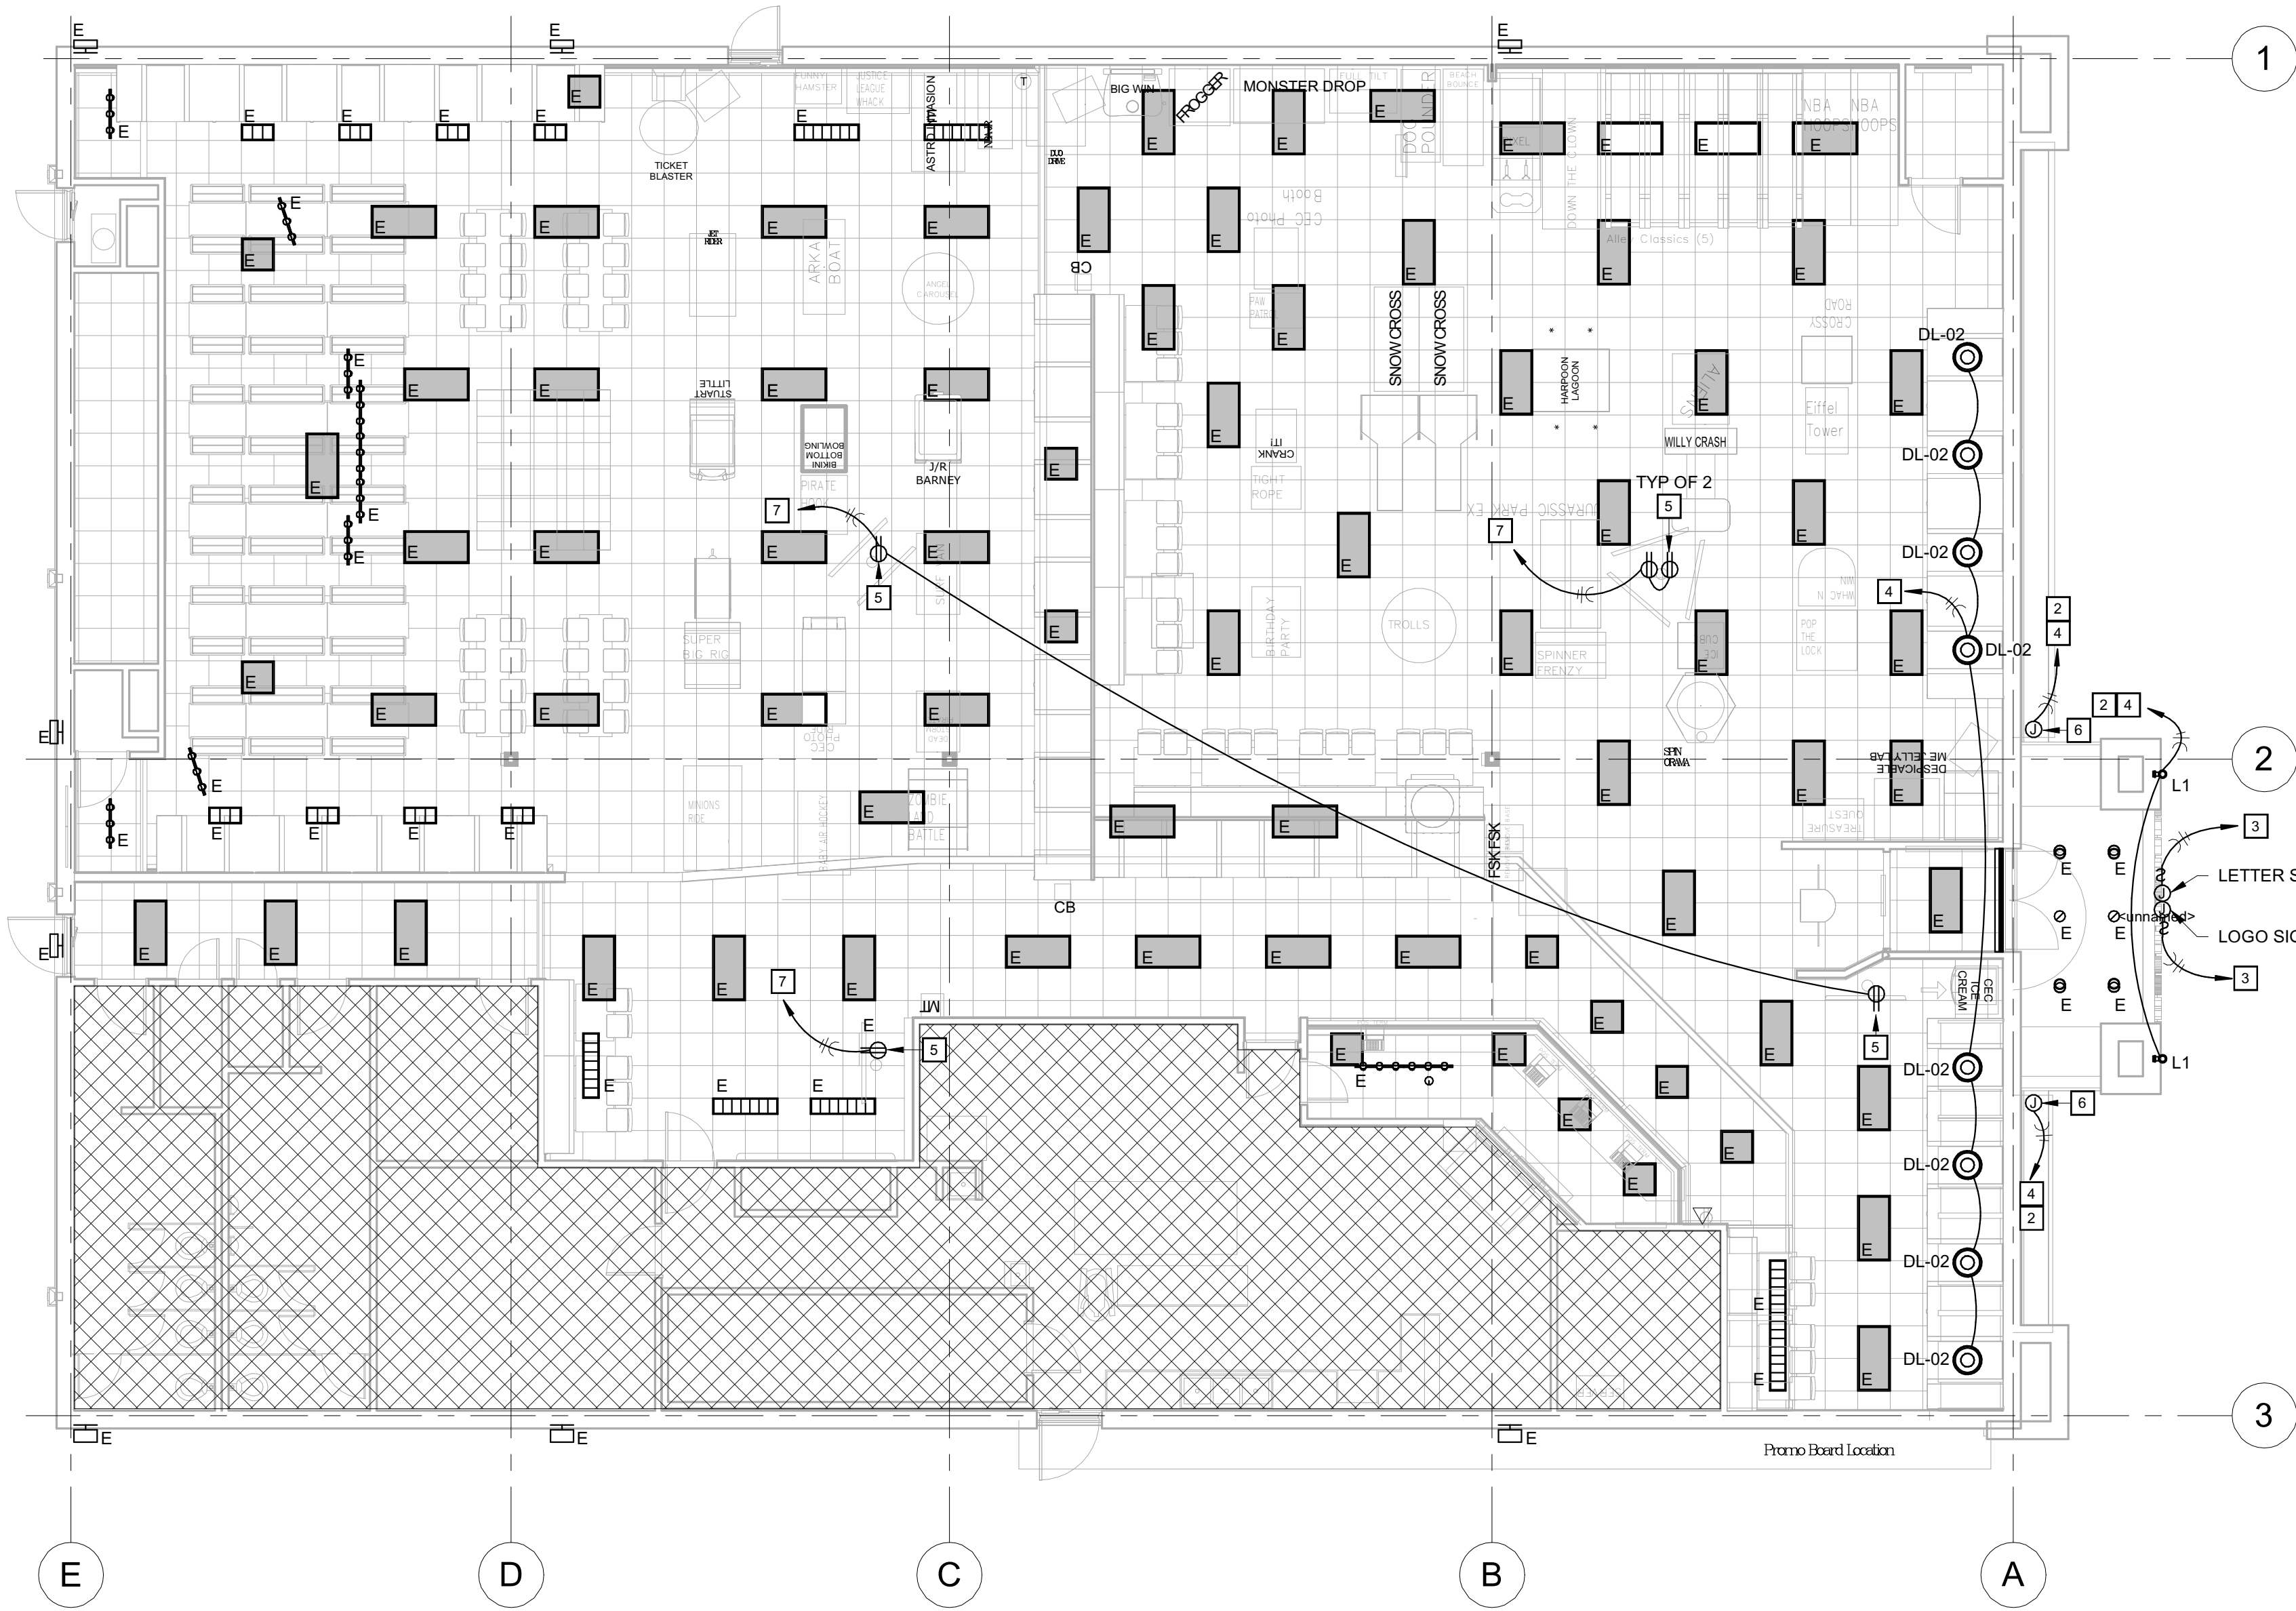

LIGHTING FLOOR PLAN

1/8" = 1'-0"

LIGHTING FIXTURE SCHEDULE

Type Mark	MANUFACTURER	CATALOG NUMBER	DESCRIPTION	LAMPS	VOLTS	FIXTURE WATTS	REMARKS
DL-02	COMMERCIAL LIGHTING IND.	CLI-CECNADL-02	FLY SUSPENSION LAMP COLOR: ORANGE; DIM 20.5"D X 13"H; 10" MAX HEIGHT	E26 MEDIUM BASE HALOGEN MAP	120 V	43 VA	MOUNT AT 6' AFF.
L1	COMMERCIAL LIGHTING IND.	CLI-CECNADL-01	EXTERIOR WALL SCONCE LED TUBE DOWN OUTDOOR WALL LIGHT. COLOR: BLACK; DIM. 5"L X 7"H X 6" EXTENSION	LED LAMP INCLUDED	120 V	18 VA	Labeled for WET LOCATION

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE DOCUMENTS, AS THESE ELEMENTS ARE SHOWN ONLY FOR REFERENCE, AND REQUIRE VERIFICATION PRIOR TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.

D **dialectic**
ENGINEERING

Dialectic, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108

T 816-997-9601
F 816-997-9602
DialecticEng.com

Florida Certificate of
Authorization Number 8039

Date
Copyright 2021



#718

7419 International Dr.
Orlando, FL 32819

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd


Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Bill Pounds

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997-9627
Contact: Joe Hillebrenner, P.E.

Design Directive: 43

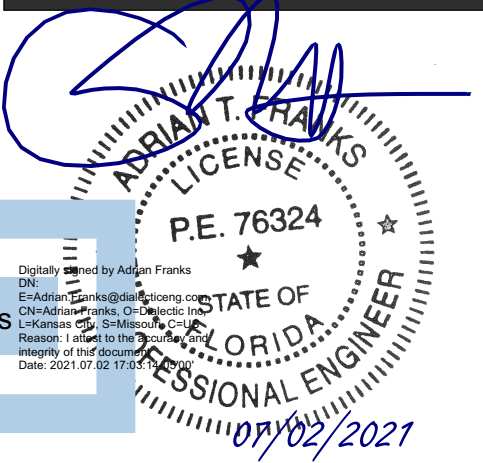

No.	Description	Date
A	PERMIT SET	2021.05.28

DRAWN BY: JGM

CHECKED BY: ATF

PROJ. NO: 94-21751

Copyright Parkway C&A, LP 2020 ©

LIGHTING FLOOR PLAN

Approved By:
Orange County
Division of Building Safety

B2190302

E1.0

08/13/21